


RWD62 Universal Controller

Application 27

W / S mode selection - analogue

Room temperature control
 Hot water control valve
 Supply fan speed control

- Control (P or PI)
- Room temperature control
- Proportional control (0..10Vdc) of the hot water valve.
- Proportional control (0..10Vdc) of the fan speed.
- Winter/Summer selection of heating or cooling operation Y1 via analogue input
- Optional day / night set point adjustment .

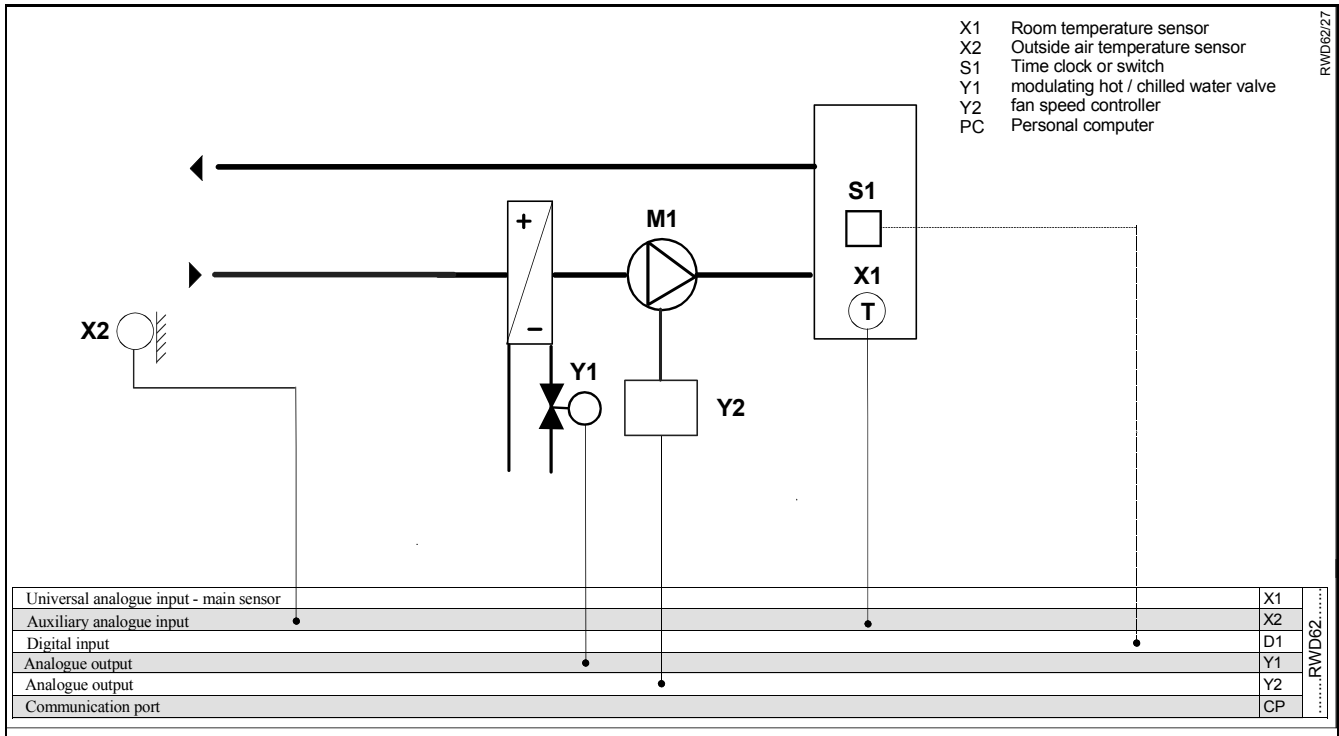

Supplemental features

Control

- Room temperature sensor can be selected as Ni1000, Pt1000, or active sensor.
- Single heating setpoint at Y1 – 0% output, no dead zone between Y1 and Y2.
- Adjustable proportional band of analogue output Y1.
- Adjustable proportional band of analogue output Y2.
- Adjustable Integral action function selection and adjustment for Y1 & Y2.
- Duct temperature sensor can be selected as Ni1000, Pt1000, or active sensor.
- Outside air temperature sensor provides the analogue input for winter / summer selection.

Operating modes

- Day / night set points can be selected via time clock or switch.
- Winter / summer selection of heating and cooling mode of the Y1 output, and heating / cooling setpoint as selected by analogue input into auxiliary input X2.
- The water supplied to the coil must be changed from heating water to chilled water and interlocked with the winter / summer change over function.

Description of operation

The temperature sensor senses the room conditions and on a fall in temperature the RWD62 via Y1 analogue output modulates the hot water valve as determined by the Y1 heating set point and proportional band (XP) setting.


On a further fall in temperature the RWD62 via the Y2 analogue output modulates the supply fan via a fan speed controller, as determined by the proportional band (XP) setting.

Y2 output begins immediately after Y1 reaches maximum output, there is no dead zone between Y1 and Y2 output.


The auxiliary temperature sensor connected to (X2) senses the outside air temperature, and when the temperature exceeds the winter / summer set point set in the controller, the controller summer set point is selected, and Y1 output is changed from heating to cooling.

Heating sequences

Function diagram

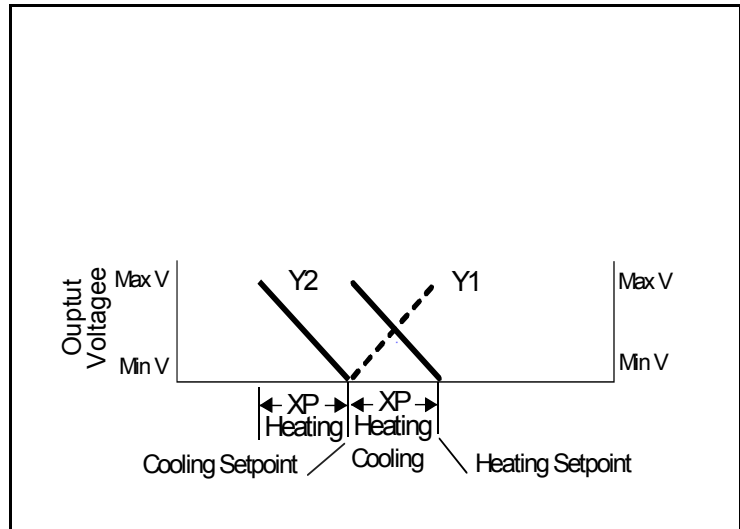

Connection diagram

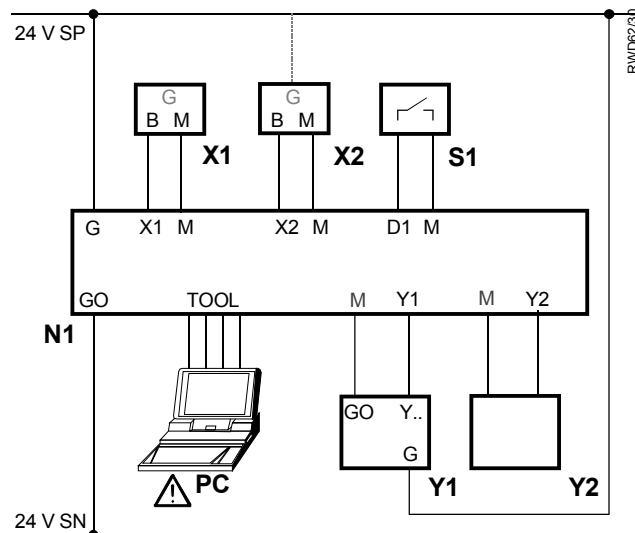

RWD62

- N1 RWD62 controller
- X1 Supply air temperature sensor
- X2 Outside air temperature sensor
- S1 Time clock or switch
- Y1 Heating / cooling control valve with 0..10Vdc input
- Y2 Fan speed controller with 0..10Vdc input
- PC Personal computer

Main Display

The main display shows ,

- a) Y1 output in Volts dc. (0..10V = 0..100% range)
- b) Y2 output in Volts dc. (0..10V = 0..100% range)
- c) Whether day or night set point is selected. (☒ = day, (= night)
- d) X1 value (room temperature) in ° C.

Other displays are available by pressing the + button, and the various displays are listed below in sequence from the main display.

On entering any of the four set point displays, the setpoint on display can be adjusted by pushing the ● enter/save button, increase value by pressing the ▲+ button or decrease the value by pressing the ▼- button, and when the required value is reached, press the ●enter/save button to save the new value.

The alternative displays return to the main display after 20 seconds.

Press buttons	Action	Current display	Selected display	Selected display comments.
▲	Push + button	Y1 Y2 ☒ X1	SP – h ☒ 25.0c	heating day set point.
▲	Push + button	SP – h ☒ 25.0c	SP – h (16.0c	heating night set point.
▲	Push + button	SP – h (16.0c	X1 22.0c	X1 - main temperature sensor reading
▲	Push + button	X1 22.0c	X2 19.0c	X2 - outside air temperature sensor reading
▲	Push + button	X2 19.0c	Y1 5.0	Y1 – heating analogue output value in Vdc to one decimal point
▲	Push + button	Y1 5.0	Y2 0.0	Y2 – heating analogue output value in Vdc to one decimal point.
▲	Push + button	Y2 0.0	WIN/SUM 27 ANLG	Control sequence diagram and application number display.
▲	Push + button	WIN/SUM 27 ANLG	Y1 Y2 ☒ X1	Back to main display.

Values shown are either default values or nominated for information only

Alternatives

- 1) Proportional control of electric heater bank via SEM61.4 signal converter with SEA 41.2 current valve, and fan speed control.