


**RWD62 Universal Controller**  
**Application 38**  
**Maximum priority**

Room temperature control  
 Hot water control valve  
 Chilled water control valve

- Control (P or PI)
- Room temperature control
- Proportional control ( 0..10Vdc ) of the hot water valve.
- Proportional control ( 0..10Vdc ) of the chilled water valve.
- Maximum priority function to control the cooling valve.
- Optional day / night set point adjustment .

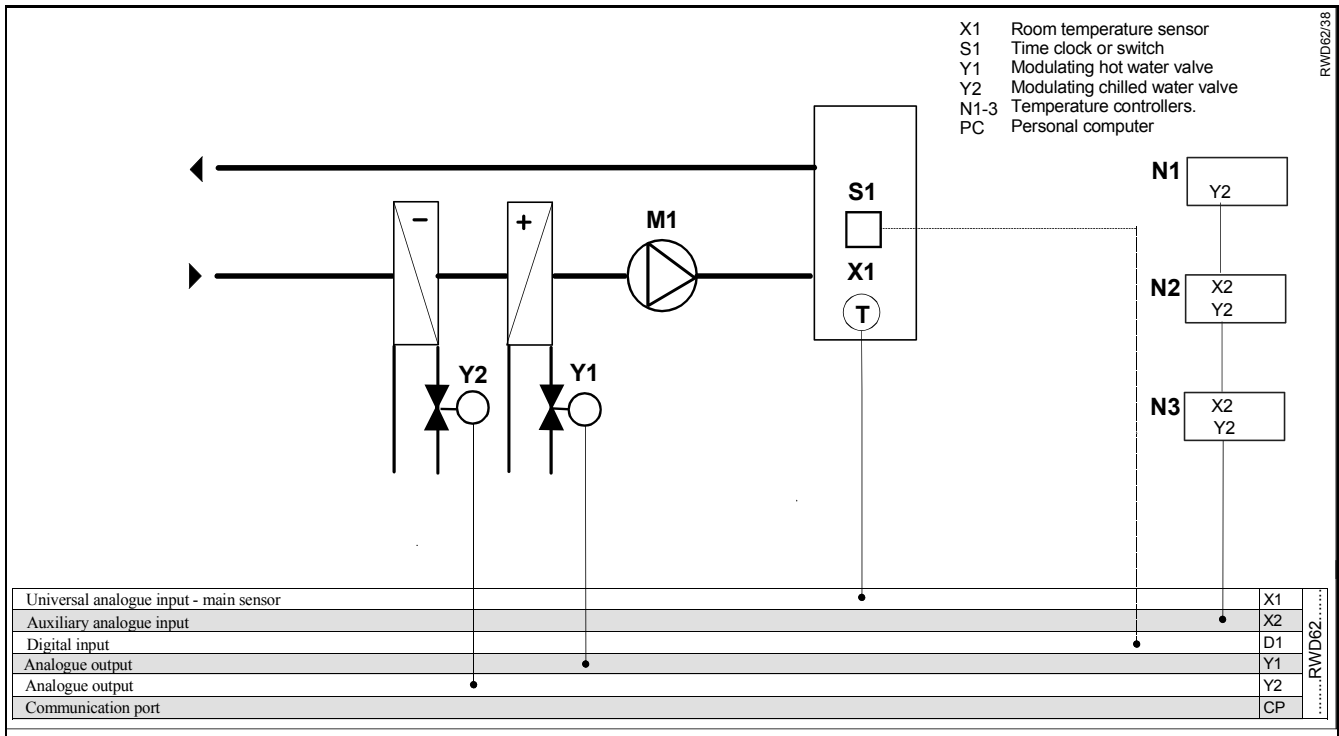

**Supplemental features**

**Control**

- Room temperature sensor can be selected as Ni1000, Pt1000, or active sensor.
- Adjustable dead zone with separate heating and cooling set points.
- Adjustable proportional band of analogue output Y1.
- Adjustable proportional band of analogue output Y2.
- Adjustable Integral action function selection and adjustment for Y1 & Y2.
- The cooling coil control valve is controlled by the highest call for cooling from a number of zones via the priority function in the temperature controller.

**Operating modes**

- Day / night set points can be selected via time clock or switch.

**Description of operation**


The temperature sensor senses the room conditions and on a fall in temperature the RWD62 via Y1 analogue output modulates the hot water valve as determined by the heating set point and proportional band (XP) setting.

On a rise in temperature the RWD62 via the Y2 analogue output modulates the chilled water valve as determined by the cooling setpoint and the proportional band (XP) setting


The connection of a number of temperature controllers in series, the cooling Y2 output of the previous controller connected to the X2 input of the following controller, together with the maximum priority function in each controller, results in the highest call for cooling controlling the position of the chilled water valve.

Heating and cooling sequences

**Function diagram**

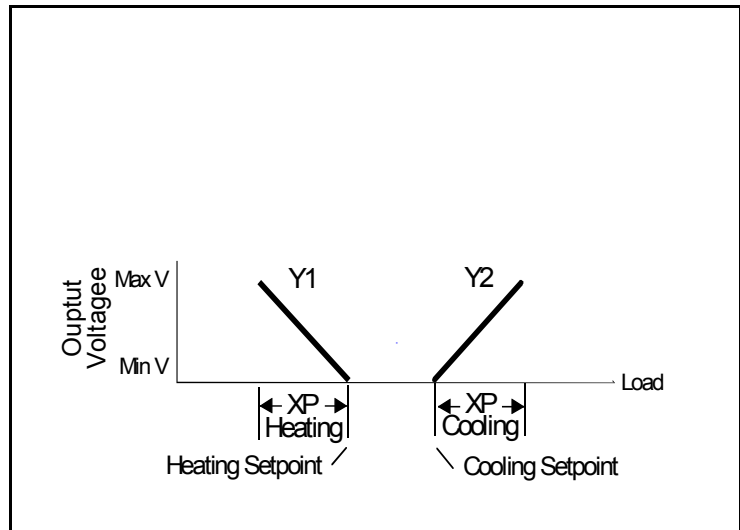

**Connection diagram**

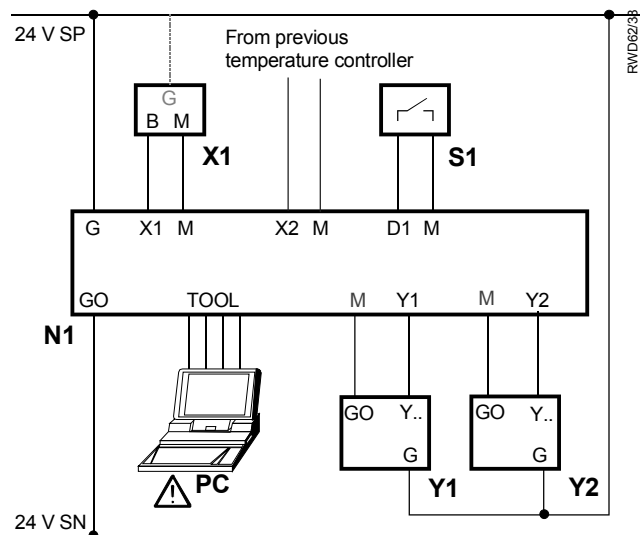

**RWD62**

- N1 RWD62 controller
- X1 Main temperature sensor
- X2 Input from previous controller
- S1 Time clock or switch
- Y1 Heating control valve with 0..10Vdc input
- Y2 Cooling control valve with 0..10Vdc input
- PC Personal computer

## Main Display



The main display shows ,

- Y1 output in Volts dc. (0..10V = 0..100% range)
- Y2 output in Volts dc. (0..10V = 0..100% range)
- Whether day or night set point is selected. ( ☒ = day, ( = night)
- X1 value ( room temperature) in ° C.

Other displays are available by pressing the + button, and the various displays are listed below in sequence from the main display.

On entering any of the four set point displays, the setpoint on display can be adjusted by pushing the ● enter/save button, increase value by pressing the ▲+ button or decrease the value by pressing the ▼- button, and when the required value is reached, press the ●enter/save button to save the new value.

The alternative displays return to the main display after 20 seconds.

Press buttons	Action	Current display	Selected display	Selected display comments.
▲	Push + button	Y1 Y2 ☒ X1	Y1 SP – h ☒ 25.0c	Y1 heating day set point.
▲	Push + button	Y1 SP – h ☒ 25.0c	Y2 SP – c ☒ 28.0c	Y2 cooling day set point.
▲	Push + button	Y2 SP – c ☒ 28.0c	Y1 SP – h ( 16.0c	Y1 heating night set point.
▲	Push + button	Y1 SP – h ( 16.0c	Y2 SP – c ( 32.0c	Y2 cooling night set point.
▲	Push + button	Y2 SP – c ( 32.0c	X1 22.0c	X1 - main temperature sensor reading
▲	Push + button	X1 22.0c	X2 5.0	X2 – cooling analogue input value in Vdc to one decimal point.
▲	Push + button	X2 5.0	Y1 5.0	Y1 – heating analogue output value in Vdc to one decimal point
▲	Push + button	Y1 5.0	Y2 0.0	Y2 – cooling analogue output value in Vdc to one decimal point.
▲	Push + button	Y2 0.0	Max Prior  38	Control sequence diagram and application number display.
▲	Push + button	Max Prior  38	Y1 Y2 ☒ X1	Back to main display.

Values shown are either default values or nominated for information only

### Alternatives

- Proportional control of electric heater bank via SEM61.4 signal converter with SEA 41.2 current valve, and modulating chilled water valve.