


RWD68 Universal Controller
Application 50

Room temperature control
 Hot water control valve
 DX cooling

- Control (P or PI)
- Room temperature control
- Proportional control (0..10Vdc) of the hot water valve.
- On/off control of DX cooling (refrigeration package unit)
- Optional day / night set point adjustment .

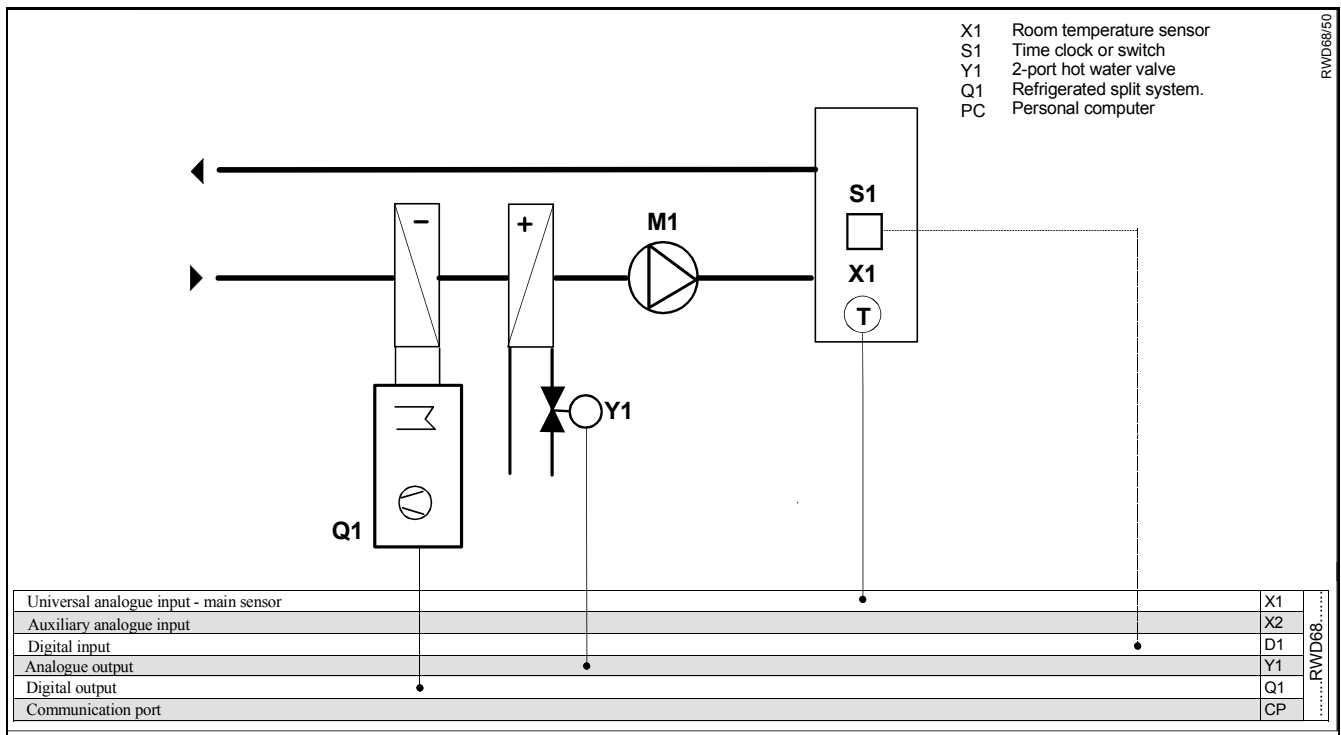

Supplemental features

Control

- Room temperature sensor can be selected as Ni1000, Pt1000, or active sensor.
- Adjustable dead zone with separate heating and cooling set points.
- Adjustable differential of digital output Q1.
- Adjustable proportional band of analogue output Y1.
- Integral action function selection and adjustment.

Operating modes

- Day / night set points can be selected via time clock or switch.

Safety functions

- Safety functions are built into the condensing unit of the refrigerated split system.


Description of operation

The temperature sensor senses the room conditions and on a fall in temperature the RWD68 via Y1 analogue output modulates the hot water valve as determined by the heating set point and proportional band (XP) settings.


On a rise in temperature the RWD68 via the Q1 digital output switches the condensing unit of the refrigerated system to provide cooling as determined by cooling set point and differential settings.

Heating and cooling sequences

Function diagram

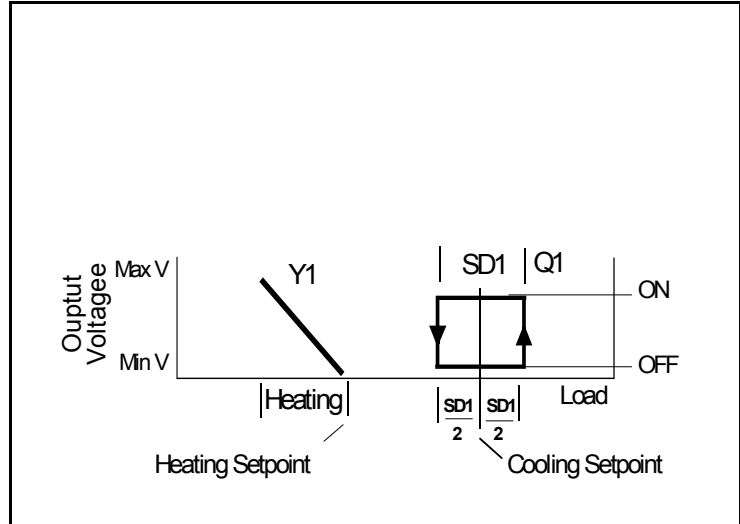

Connection diagram

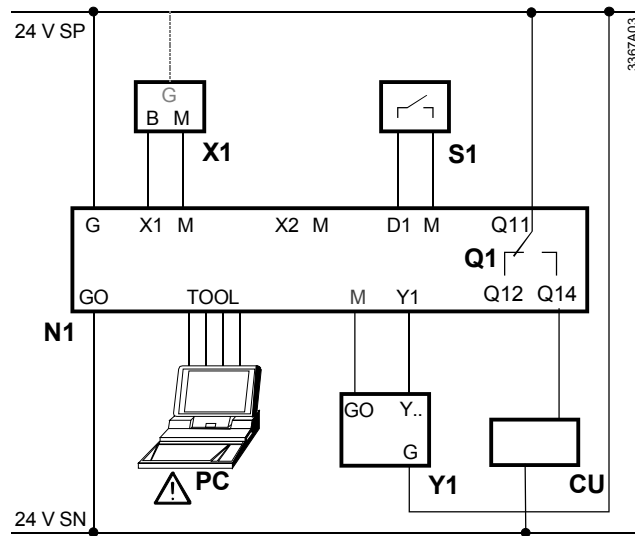



RWD68



- N1 RWD68 controllers
- X1 Main temperature sensor
- S1 Time clock or switch
- Q1 Potential-free relay contacts for 2-position
- Y1 Heating control valve
- CU Condensing unit.
- PC Personal computer

Main Display



The main display shows ,

- a) Whether Q1 is On or Off ( = off,  = on)
- b) Y1 output in Volts dc. (0..10V = 0..100% range)
- c) Whether day or night set point is selected. (\boxtimes = day, \sphericalangle = night)
- d) X1 value (room temperature) in ° C.

Other displays are available by pressing the + button, and the various displays are listed below in sequence from the main display.

On entering any of the four set point displays, the setpoint on display can be adjusted by pushing the  enter/save button, increase value by pressing the \blacktriangle + button or decrease the value by pressing the \blacktriangledown - button, and when the required value is reached, press the  enter/save button to save the new value.

The alternative displays return to the main display after 20 seconds.

Press buttons	Action	Current display	Selected display	Selected display comments.
\blacktriangle	Push + button	Q1 Y1 \boxtimes X1	Y1 SP – h \boxtimes 19.0c	Y1 heating day set point.
\blacktriangle	Push + button	Y1 SP – h \boxtimes 19.0c	Q1 SP – c \boxtimes 21.0c	Q1 cooling day set point.
\blacktriangle	Push + button	Q1 SP – c \boxtimes 21.0c	Y1 SP – h \sphericalangle 15.0c	Y1 heating night set point.
\blacktriangle	Push + button	Y1 SP – h \sphericalangle 15.0c	Q1 SP – c \sphericalangle 25.0c	Q1 cooling night set point.
\blacktriangle	Push + button	Q1 SP – c \sphericalangle 25.0c	X1 18.0c	X1 - main temperature sensor reading
\blacktriangle	Push + button	X1 18.0c	Y1 5.0	Y1 – heating analogue output value in Vdc to one decimal point
\blacktriangle	Push + button	Y1 5.0	Q1 OFF	Q1 – cooling digital output, display shows if relay is on or off.
\blacktriangle	Push + button	Q1 OFF	 50	Control sequence diagram and application number display.
\blacktriangle	Push + button	 50	Q1 Y1 \boxtimes X1	Back to main display.

Values shown are either default values or nominated for information only

Alternatives

- 1) Modulating hot water valve and two position chilled water valve.