





- Heating with LTHW radiator
- Modulating control of heating valve on analog output
- Downdraft compensation
- Room temperature operation via KNX PL-Link room operator unit with temperature measurement

Plant diagram

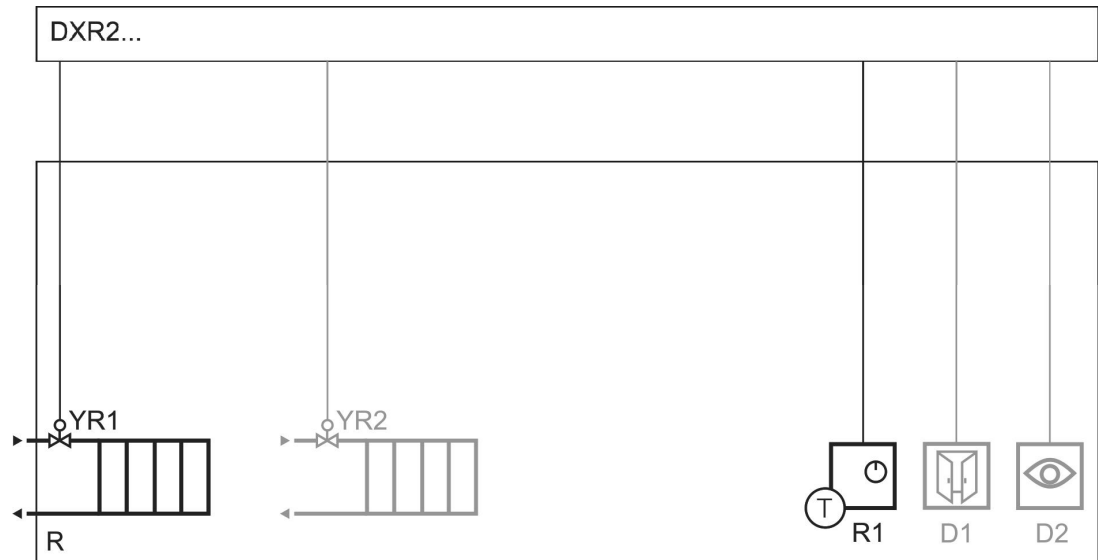

DXR2...	Room automation station	R1	Room operator unit with temperature sensor
D1	Window contact	YR1	Radiator valve 1
D2	Presence detector	YR2	Radiator valve 2
R	Room		

Function diagrams

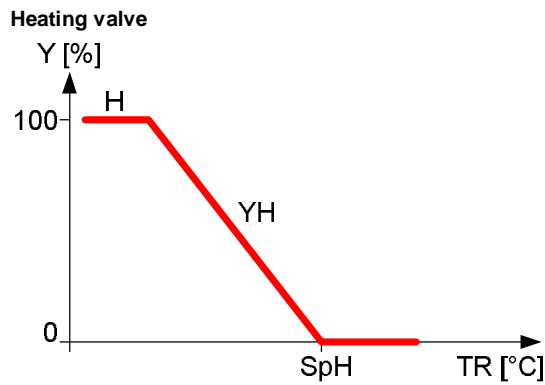

H	Heating sequence	Y	Output signal
SpH	Effective heating setpoint	YH	Heating valve
TR	Room temperature		

Description of functions**Basic functions**

- PID control for heating.
- 0...10 V valves controlled by analog outputs for heating.
- The temperature is measured in the room operator unit.
- The application allows customers to adjust the room temperature setpoints via the room operator unit.
- The operating modes are Comfort, Pre-Comfort, Economy and Protection.
- Change of operating mode via room unit, presence detector, window contact or central command.
- Draft compensation.
- Outside temperature (for draft compensation) distributed over BACnet.

Auxiliary functions

- Green Leaf (RoomOptiControl) function.
- Multisegment use of DXR2 automation stations.
- Standard hot water supply chain control.
- The application allows for control via centralized commands (e.g. scheduler program for room operating mode).
- Central optimum start control provides best room comfort at the start of occupancy.
- Central operation or reset of setpoints, timed valve kick function or outside temperature dependent heating limit.
- Central override functions for valves.
- Seasonal compensation of room temperature setpoints.

Options

- 2nd radiator.
- Optimal energy efficiency by presence detector or window contact.
- Optional system alarms displayed on the management station notify building operators of possible faults.
- Optional trends can be activated for room sensors.

Variants

- The room temperature can be measured by:
 - KNX PL-Link wall-mount sensor
 - KNX PL-Link flush-mount room operator unit
 - KNX PL-Link flush-mount sensors
- Presence can be detected by KNX PL-Link sensor or binary sensor.

Siemens devices	Legend	Type of unit	Data sheet	Product No.	Qty.
DXR2...		Compact room automation station, BACnet/IP, 230 V, flat housing, 1 DI, 2 UI, 3 DO relays, 3 AO 0...10 V	N9204	DXR2.E09-101A	1
R1		KNX PL-Link room operator unit with temperature sensor, segmented backlit display, touchkeys	N1602	QMX3.P34	1
YR1		2-port, 3-port valve or 3-port valves with bypass, PN16	N4845	V..P45..	1
		Electromotive actuator, AC/DC 24 V, DC 0...10 V	N4864	SSP61	1

Optional ¹⁾	Legend	Type of unit	Data sheet	Product No.	Qty.
D1		Door/window contact, white	²⁾	S 290/11	³⁾
D2		KNX PL-Link presence detector with brightness sensor	²⁾	UP 258D12	1 - 4
YR2		2-port, 3-port valve or 3-port valves with bypass, PN16	N4845	V..P45..	1
		Electromotive actuator, AC/DC 24 V, DC 0...10 V	N4864	SSP61	1


¹⁾ Can be combined according to available on-board I/Os on controller.

²⁾ Further documents on www.siemens.com/gamma-td.

³⁾ Type of operation (NO or NC). Multiple devices of the same type can be connected.

Variants	Legend	Type of unit	Data sheet	Product No.	Qty.
R1 _a		KNX PL-Link wall-mount room sensor for temperature	N1602	QMX3.P30	1
R1 _b		KNX PL-Link flush-mount room operator unit	N1601	QMX3.P36	1
R1 _c		KNX PL-Link flush-mount room sensors	N1411	AQR253... AQR257...	1

Connection diagram

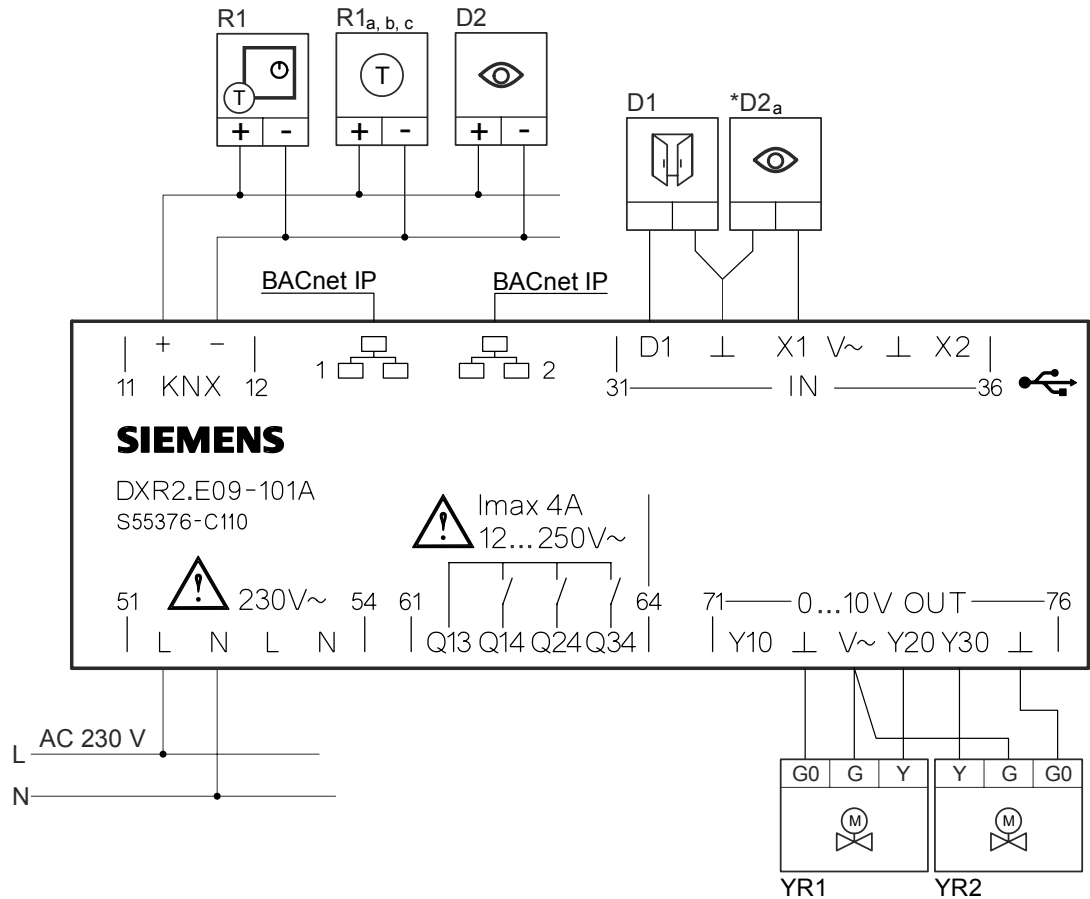

*3rd party device

Application configuration

	Equipment	Values/Range	Template settings
On-board output	Radiator valve position 1	Water; Y20; 0...10 V Water; Y30; 0...10 V Electric modulating; Y20; 0...10 V Electric modulating; Y30; 0...10 V	Water; Y20; 0...10 V
KNX PL-Link devices	Room operator unit device 1	QMX3.P02, QMX3.P34, QMX3.P36, QMX3.P37, QMX3.P74	QMX3.P34

Optional configuration


	Equipment	Values/Range	Template settings
On-board output	Radiator valve position 2	Water; Y20; 0...10 V Water; Y30; 0...10 V Electric modulating; Y20; 0...10 V Electric modulating; Y30; 0...10 V	Water; Y30; 0...10 V
On-board input	Presence detector 2 (D2a)		X1, Normally open
	Window contact (D1)		D1; Normally closed
KNX PL-Link devices	Sensor device 1...4 (D2)		JP 258D12

Default values

	Parameter	Values/Range	Template settings
Temperature setpoints	Heating setpoint for Comfort	0 ... 50 °C	21 °C
	Delta heating setpoint for Pre-comfort	0 ... 10 K	1 K
	Heating setpoint for Economy	0 ... 50 °C	15 °C
	Heating setpoint for Protection	0 ... 50 °C	12 °C
Room operator unit	Room unit, display temperature	None Display room temperature	Display room temperature
	Room unit, display windows status	Yes, No	No
	Room unit, display heat./cool. status	Yes, No	Yes
	Enable operation: room temp. setpoint	Yes, No	Yes
	Room unit, room temp. setpoint display	Absolute temperature setpoint Relative setpoint shift	Relative setpoint shift
	Enable operation: fan speed setpoint	Yes, No	No
	Enable operation: presence button	Yes, No	No
	Enable operation: temporary Comfort	Yes, No	No
	Enable operation: room op. mode	Yes, No	No
Enable operation: Green Leaf	Yes, No	Yes	

Engineering

- ABT Site engineering tool is required to configure the DXR2 automation stations.
- See the Siemens Download Center at www.siemens.com/bt/download for the latest application configuration and workflow tutorials.
- Option combination according to available on-board I/Os on controller.
- D2_a (on-board presence detector) to be configured in ABT Site under 'Presence detector 2' for maximum combination of optional devices.
Type of operation (NO or NC). Multiple devices of the same type can be connected.

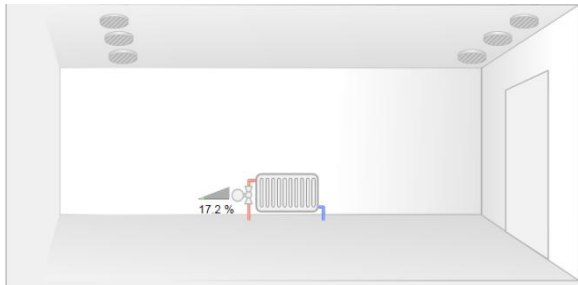Management station

Sample presentation of a radiator application on the Desigo CC management station.

Siemens Switzerland Ltd
Building Technologies Division
International Headquarters
Gubelstrasse 22
CH-6301 Zug
Tel. +41 41-724 24 24
Fax +41 41-724 35 22

www.siemens.com/buildingtechnologies

© 2015 Siemens Switzerland Ltd
Subject to change