





- Heating or cooling with chilled ceiling with changeover with 6-way valve on analog output
- Modulating control of heating and cooling valve
- Condensation monitoring
- Room temperature operation via KNX PL-Link room operator unit with temperature measurement

Plant diagram

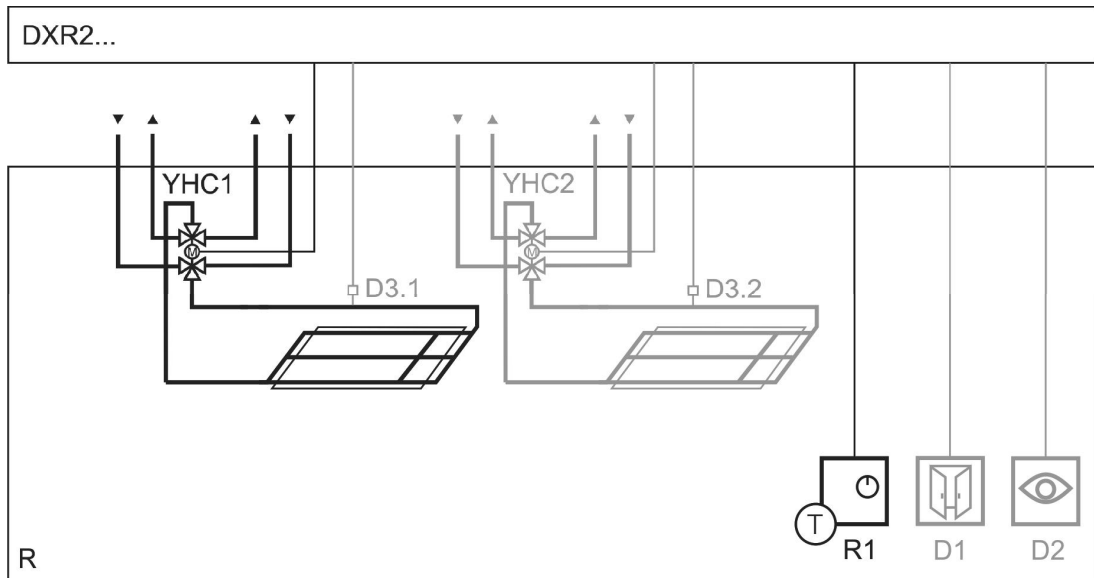

DXR2...	Room automation station	R	Room
D1	Window contact	R1	Room operator unit with temperature sensor
D2	Presence detector		
D3.1	Condensation monitor 1	YHC1	Heating/cooling valve 1
D3.2	Condensation monitor 2	YHC2	Heating/cooling valve 2

Function diagrams 6-way valve

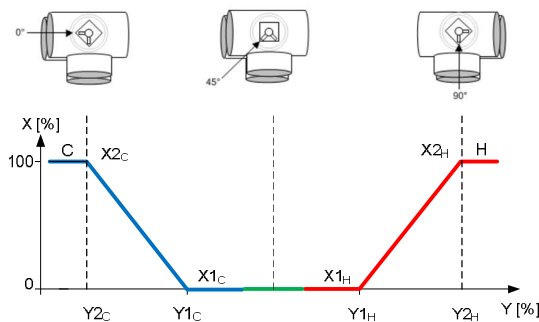

C	Cooling sequence	X2 _H	Heating coil valve position for value X2
H	Heating sequence	Y	Valve output signal
X	Valve opening	Y1 _C	Cooling coil valve position for value Y1
X1 _C	Cooling coil valve position for value X1	Y1 _H	Heating coil valve position for value Y1
X1 _H	Heating coil valve position for value X1	Y2 _C	Cooling coil valve position for value Y2
X2 _C	Cooling coil valve position for value X2	Y2 _H	Heating coil valve position for value Y2

Description of functions**Basic functions**

- PID control for heating and cooling.
- 6-way valves 0...10 V controlled by analog outputs for heating and cooling.
- The temperature is measured in the room operator unit.
- The application allows customers to adjust the room temperature setpoints via the room operator unit.
- The operating modes are Comfort, Pre-Comfort, Economy and Protection.
- Change of operating mode via room unit, presence detector, window contact or central command.

Auxiliary functions

- Green Leaf (RoomOptiControl) function.
- Multisegment use of DXR2 automation stations.
- The application allows for control via centralized commands (e.g. scheduler program for room operating mode).
- Central optimum start control provides best room comfort at the start of occupancy.
- Central operation or reset of setpoints, timed valve kick function.
- Central override functions for valves.
- Seasonal compensation of room temperature setpoints.

Options

- 2nd chilled/heated ceiling.
- Condensation monitoring.
- Optimal energy efficiency by presence detector or window contact.
- Optional system alarms displayed on the management station notify building operators of possible faults.
- Optional trends can be activated for room sensors.

Variants

- The room temperature can be measured by:
 - KNX PL-Link wall-mount sensor
 - KNX PL-Link flush-mount room operator unit
 - KNX PL-Link flush-mount sensors
- Presence can be detected by KNX PL-Link sensor or binary sensor.

Siemens devices	Legend	Type of unit	Data sheet	Product No.	Qty.
	DXR2...	Compact room automation station, BACnet/IP, 230 V, flat housing, 1 DI, 2 UI, 3 DO relays, 3 AO 0...10 V	N9204	DXR2.E09-101A	1
			N9206	DXR2.M09-101A	
	R1	KNX PL-Link room operator unit with temperature sensor, segmented backlit display, touchkeys	N1602	QMX3.P34	1
	YHC1	6-way valve	A6V10564480	VWG41.20..	1
		Electromotive actuator, AC 24 V, DC 0...10 V	N4657	GDB161.9E	1

Optional ¹⁾	Legend	Type of unit	Data sheet	Product No.	Qty.
	D1	Door/window contact, white	²⁾	S 290/11	³⁾
	D2	KNX PL-Link presence detector with brightness sensor	²⁾	UP 258D12	1 - 4
	D3.1	Condensation monitor	A6V10741072	QXA21..	1
	D3.2	Condensation monitor	A6V10741072	QXA21..	1
	YHC2	6-way valve	A6V10564480	VWG41.20..	1
		Electromotive actuator, AC 24 V, DC 0...10 V	N4657	GDB161.9E	1


¹⁾ Can be combined according to available on-board I/Os on controller.

²⁾ Further documents on www.siemens.com/gamma-td.

³⁾ Type of operation (NO or NC). Multiple devices of the same type can be connected.

Variants	Legend	Type of unit	Data sheet	Product No.	Qty.
R1 _a		KNX PL-Link wall-mount room sensor for temperature	N1602	QMX3.P30	1
R1 _b		KNX PL-Link flush-mount room operator unit	N1601	QMX3.P36	1
R1 _c		KNX PL-Link flush-mount room sensors	N1411	AQR253... AQR257...	1

Connection diagram

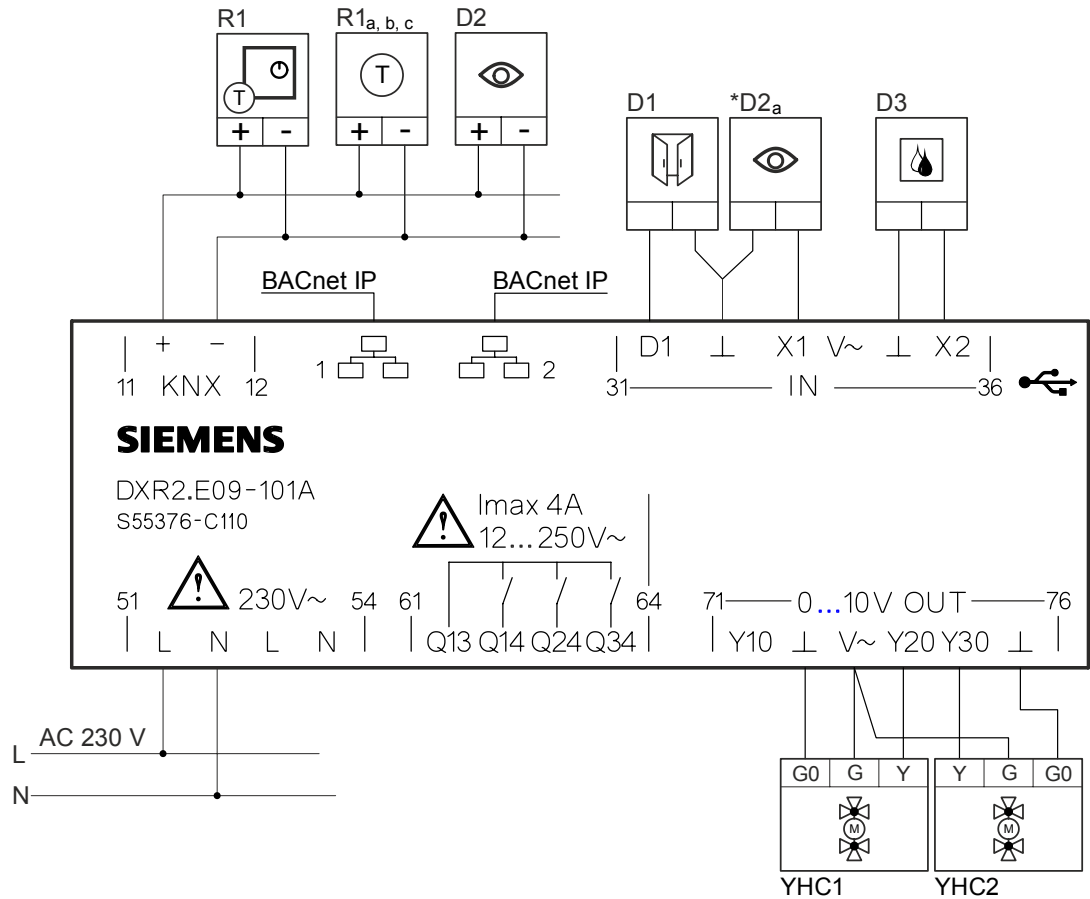

*3rd party device

Application configuration

	Equipment	Values/Range	Template settings
On-board output	Radiant ceiling valve position 1	Chilled; Y20; 0...10 V Chilled; Y30; 0...10 V Heating/chilled 2-pipe; Y20; 0...10 V Heating/chilled 2-pipe; Y30; 0...10 V Heating/chilled 4-pipe 6-way; Y20; 0...10 V Heating/chilled 4-pipe 6-way; Y30; 0...10 V Heating; Y20; 0...10 V Heating; Y30; 0...10 V	Heating/chilled 4-pipe 6-way; Y20; 0...10 V
KNX PL-Link devices	Room operator unit device 1	QMX3.P02, QMX3.P34, QMX3.P36, QMX3.P37, QMX3.P74	QMX3.P34

Optional configuration

	Equipment	Values/Range	Template settings
On-board output	Radiant ceiling valve position 2	Chilled; Y20; 0...10 V Chilled; Y30; 0...10 V Heating/chilled 2-pipe; Y20; 0...10 V Heating/chilled 2-pipe; Y30; 0...10 V Heating/chilled 4-pipe 6-way; Y20; 0...10 V Heating/chilled 4-pipe 6-way; Y30; 0...10 V Heating; Y20; 0...10 V Heating; Y30; 0...10 V	Heating/chilled 4-pipe 6-way; Y30; 0...10
On-board input	Presence detector 2 (D2a)		X1, Normally open
	Window contact (D1)		D1; Normally closed
	Condensation monitor (D3.1, D3.2)		X2; Normally closed
KNX PL-Link devices	Sensor device 1...4 (D2)		JP 258D12

Default values

	Parameter	Values/Range	Template settings
Temperature setpoints	Cooling setpoint for Comfort	0 ... 50 °C	24 °C
	Delta cooling setpoint for Pre-comfort	0 ... 10 K	1 K
	Cooling setpoint for Economy	0 ... 50 °C	35 °C
	Cooling setpoint for Protection	0 ... 50 °C	40 °C
	Heating setpoint for Comfort	0 ... 50 °C	21 °C
	Delta heating setpoint for Pre-comfort	0 ... 10 K	1 K
	Heating setpoint for Economy	0 ... 50 °C	15 °C
	Heating setpoint for Protection	0 ... 50 °C	12 °C
Radiant ceiling	Enable condensation monitor input	Yes, No	Yes
	Chilled ceiling valve pos. for value X1	0 ... 100 %	0 %
	Chilled ceiling valve pos. for value Y1	0 ... 100 %	50 %
	Chilled ceiling valve pos. for value X2	0 ... 100 %	100 %
	Chilled ceiling valve pos. for value Y2	0 ... 100 %	0 %
	Ceiling heating valve pos. for value X1	0 ... 100 %	0 %
	Ceiling heating valve pos. for value Y1	0 ... 100 %	50 %
	Ceiling heating valve pos. for value X2	0 ... 100 %	100 %
	Ceiling heating valve pos. for value Y2	0 ... 100 %	100 %

Default values

	Parameter	Values/Range	Template settings
Room operator unit	Room unit, display temperature	None Display room temperature	Display room temperature
	Room unit, display windows status	Yes, No	No
	Room unit, display heat./cool. status	Yes, No	Yes
	Enable operation: room temp. setpoint	Yes, No	Yes
	Room unit, room temp. setpoint display	Absolute temperature setpoint Relative setpoint shift	Relative setpoint shift
	Enable operation: fan speed setpoint	Yes, No	No
	Enable operation: presence button	Yes, No	No
	Enable operation: temporary Comfort	Yes, No	No
	Enable operation: room op. mode	Yes, No	No
	Enable operation: Green Leaf	Yes, No	Yes

Engineering

- ABT Site engineering tool is required to configure the DXR2 automation stations.
- See the Siemens Download Center at www.siemens.com/bt/download for the latest application configuration and workflow tutorials.
- Option combination according to available on-board I/Os on controller.
- D2_a (on-board presence detector) to be configured in ABT Site under 'Presence detector 2' for maximum combination of optional devices.
Type of operation (NO or NC). Multiple devices of the same type can be connected.

Management station



Sample presentation of a chilled/heated ceiling application on the Desigo CC management station.

Siemens Switzerland Ltd
Building Technologies Division
International Headquarters
Gubelstrasse 22
CH-6301 Zug
Tel. +41 41-724 24 24
Fax +41 41-724 35 22

www.siemens.com/buildingtechnologies

© 2015 Siemens Switzerland Ltd
Subject to change