


# Meter / Load Center Combinations

## General Information

### FEATURES

- UL Listed only for use as service entrance equipment.
- Lever bypass meter socket (L&G HQ5).
- Painted G90 galvanized steel, Type 3R outdoor enclosure.
- Overhead or underground feed.
- Side hinge door, only one screw required to remove door.
- 22K AIC rated main breaker included.
- Ringless type meter cover.
- Surface mount.
- 5th jaw provided.
- Uses Type RX hubs.
- 20 space / 40 circuit load center with *INSTA-WIRE* neutrals
- Deadfront pull ring.

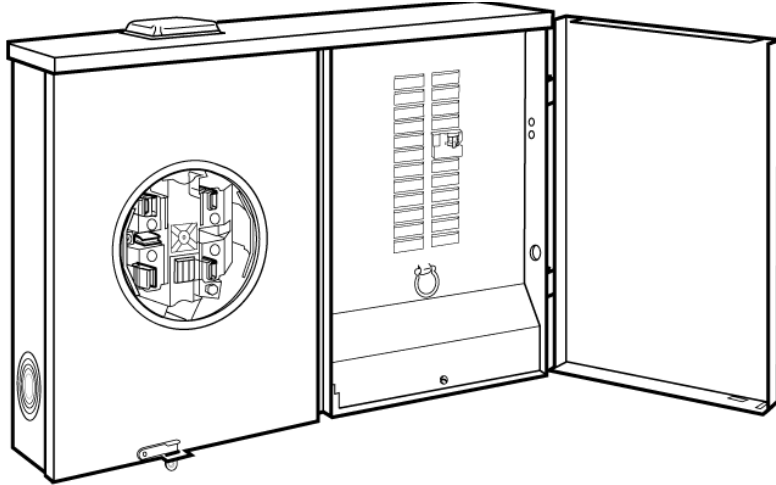


Meter Socket Ampere Rating	Catalog Number	Max. 1" Spaces	Max. Circuits	Phase	Main Ampere Rating	Number of Jaws	Type of Bypass	Type of Cover
200	MC2040B1150RJL	20	40	Single	150	5	Lever	Ringless
200	MC2040B1200RJL	20	40	Single	200	5	Lever	Ringless

***fastfax***

**SIEMENS**

# Meter / Main Combinations

## Knockout Diagram

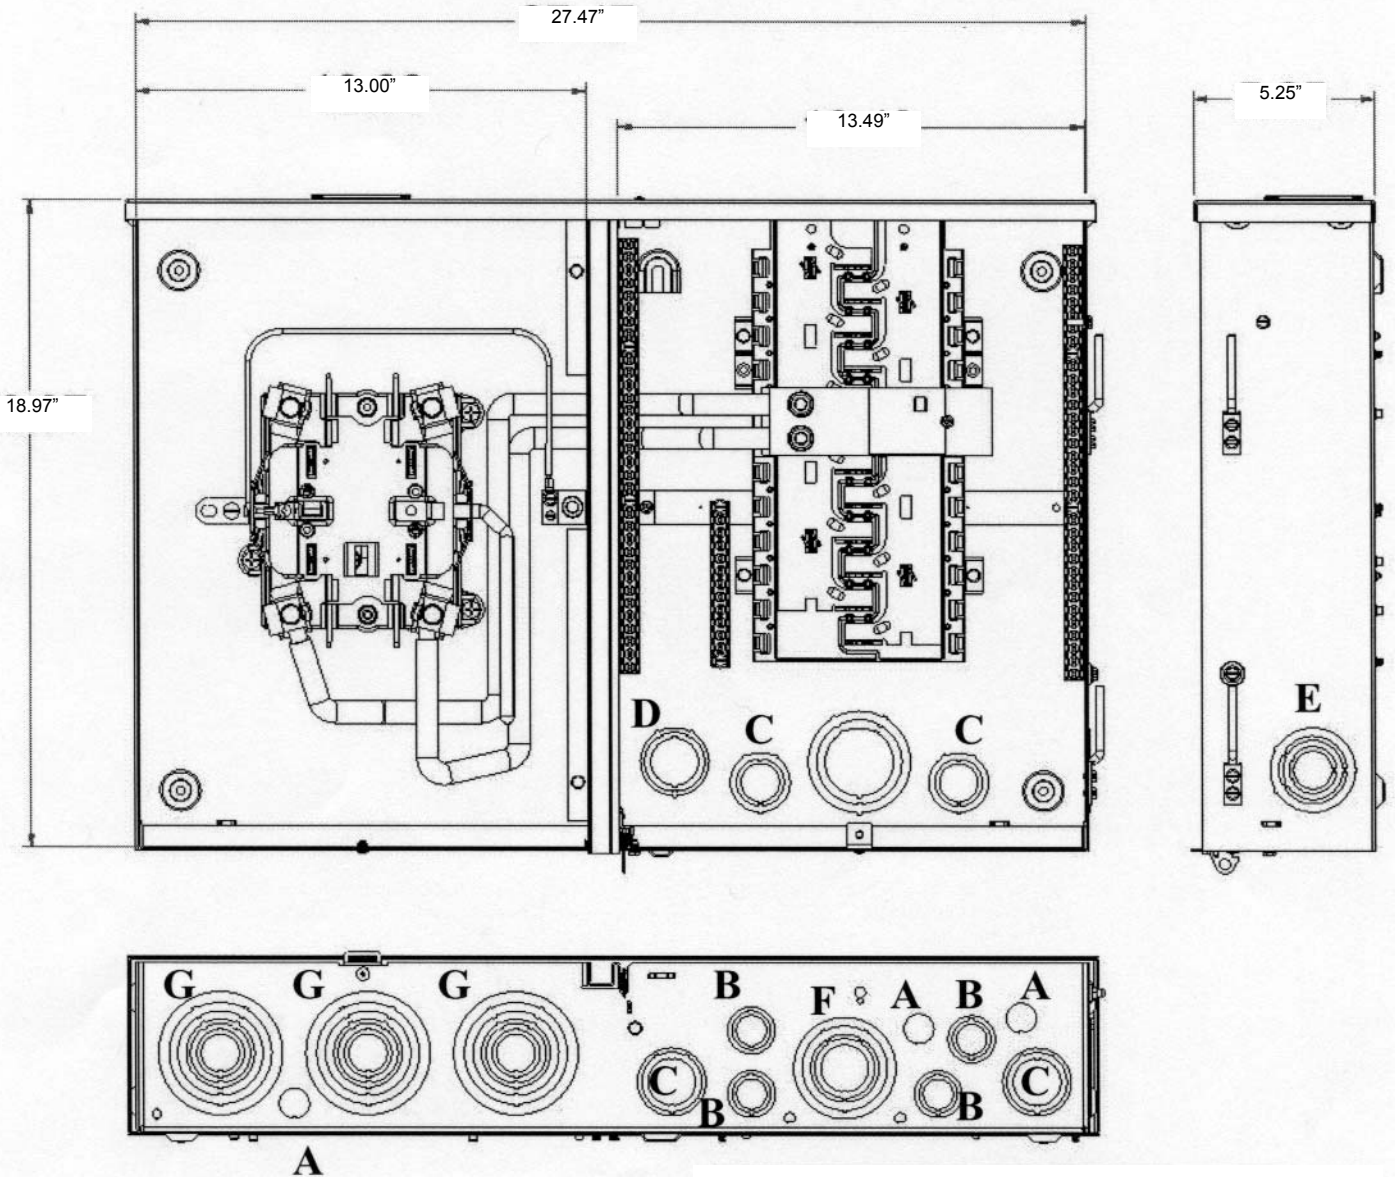

KNOCKOUT CODE
A = 1/2"
B = 1/2", 3/4", 1"
C = 3/4", 1", 1-1/2"
D = 1", 1-1/4", 1-1/2"
E = 3/4", 1", 1-1/4", 1-1/2", 2"
F = 1", 1-1/4", 1-1/2", 2", 2-1/2"
G = 1-1/4", 1-1/2", 2", 2-1/2", 3"

# SIEMENS

## Outdoor Combination Metering

Catalog number  
**MC2040B1150RJL**

**Enclosure  
Type 3R**

### Panelboard Rating

150 Amps, Max  
120/240 Volts ~, 1 phase, 3 wire  
208Y/120 Volts ~, 1 phase, 3 wire  
(Derived from 3 phase - 4 wire system)

### Meter Socket Rating

200 Amps Continuous  
Type HQ-5B  
100% Rated Clamping Jaw Lever  
Bypass


**CAUTION: Removal of meter may not de-energize circuit.**

**Suitable Only For Use As  
Service Equipment**

**For Overhead or Underground  
Service**

**Use 60/75 °C Copper or  
Aluminum Conductor in  
Terminals A, B, N1,N2, and G1.**

Unused neutral branch terminals may be used to terminate equipment grounding wires in the combinations indicated for equipment ground bar terminals.

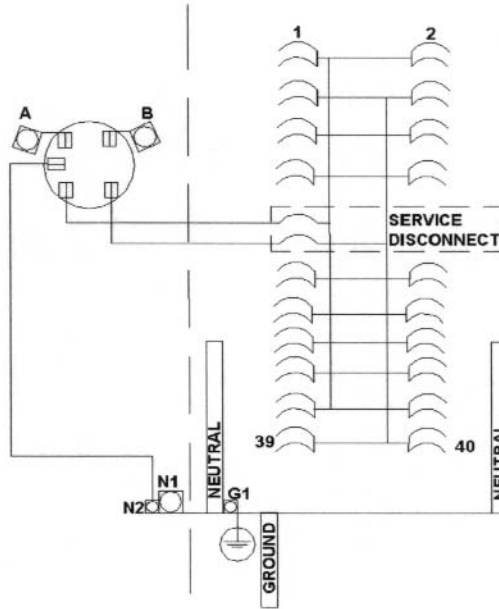

General Information:  
Circuit Breakers overload trip position is indicated by handle position midway between ON and OFF. To reset, move handle to OFF position then turn ON.  
For installation in accordance with all local Electrical codes and/or the National Electrical Code. Ⓡ

Terminal	Wire Size	Torque
A, B	350 kcmil - #6	375 lb. in.
N1	300 kcmil - #6	275 lb. in.
N2	#2-#14	50 lb. in.
G1	1/0-#14	120 lb. in.
Branch Breaker Terminals	See Markings on Breaker	
Neutral Bar/Ground Bar	#10 - #14 CU	20 lb. in.
	#10-#12 AL	20 lb. in.
	#8	25 lb. in.
	#6	35 lb. in.
Ground Conductors only	(2) or (3) #14	20 lb. in.
	(2) #12-#10	20 lb. in.

Accessories:  
Filler Plate QF3  
Equipment Grounding Bars GB series

If hub is required, the catalog numbers listed below may be used on the top of this enclosure.

Trade size (in)	Catalog number
1 1/4"	S38597-2
1 1/2"	S38598-2
2"	S38599-2
2 1/2"	S38600-2

Short Circuit Current Rating (Wattour Meter not included in short circuit rating)

This panelboard has a short circuit current rating of 22,000 Amps RMS symmetrical, 120/240 V~. The correct branch circuit breakers and main/branch breaker series combinations to be used for various short circuit current levels are listed in the tabulation below. Any circuit breaker installed, replaced, or added in this panelboard must be manufactured by Siemens and must be of the correct type as indicated in the tabulation below.

Main Breaker	Branch Breaker	Then the maximum short circuit rating in RMS symmetrical amperes, 120/240V~ is:
When the main breaker is:	And the branch breakers installed are Siemens Type:	
QNRH	QP, QPF, QPHF, QE, QEH, QAF, QAFH, QPH, HQP, QT	22,000

(J2)

Siemens Energy & Automation, Inc. Alpharetta, Georgia, USA  
Assembled in Mexico.

Part No. 4099684 Rev. A

### Important

Do not spray or allow any petroleum based chemicals, solvents, or paint to contact interior components.  
Ⓡ National Electrical Code is a registered trademark of the National Fire Protection Association.

E10703

# SIEMENS

## Outdoor Combination Metering

Catalog number

**MC2040B1200RJL**

**Enclosure  
Type 3R**

### Panelboard Rating

200 Amps, Max  
120/240 Volts ~, 1 phase, 3 wire  
208Y/120 Volts ~, 1 phase, 3 wire  
(Derived from 3 phase – 4 wire system)

### Meter Socket Rating

200 Amps Continuous  
Type HQ-5B  
100% Rated Clamping Jaw Lever  
Bypass

**CAUTION: Removal of meter may not de-energize circuit.**

**Suitable Only For Use As  
Service Equipment**

**For Overhead or Underground  
Service**

**Use 60/75 °C Copper or  
Aluminum Conductor in  
Terminals A, B, N1,N2, and G1.**

Unused neutral branch terminals may be used to terminate equipment grounding wires in the combinations indicated for equipment ground bar terminals.

### Short Circuit Current Rating (Watt-hour Meter not included in short circuit rating)


This panelboard has a short circuit current rating of 22,000 Amps RMS symmetrical, 120/240 V~. The correct branch circuit breakers and main/branch breaker series combinations to be used for various short circuit current levels are listed in the tabulation below. Any circuit breaker installed, replaced, or added in this panelboard must be manufactured by Siemens and must be of the correct type as indicated in the tabulation below.

Main Breaker	Branch Breaker	Then the maximum short circuit rating in RMS symmetrical amperes, 120/240V~ is:
When the main breaker is:	And the branch breakers installed are Siemens Type:	
QNRH	QP, QPF, QPHF, QE, QEH, QAF, QAFH, QPH, HQP, QT	22,000

(J2)

Siemens Energy & Automation, Inc. Alpharetta, Georgia, USA  
Assembled in Mexico.

Part No. 4099683 Rev. A

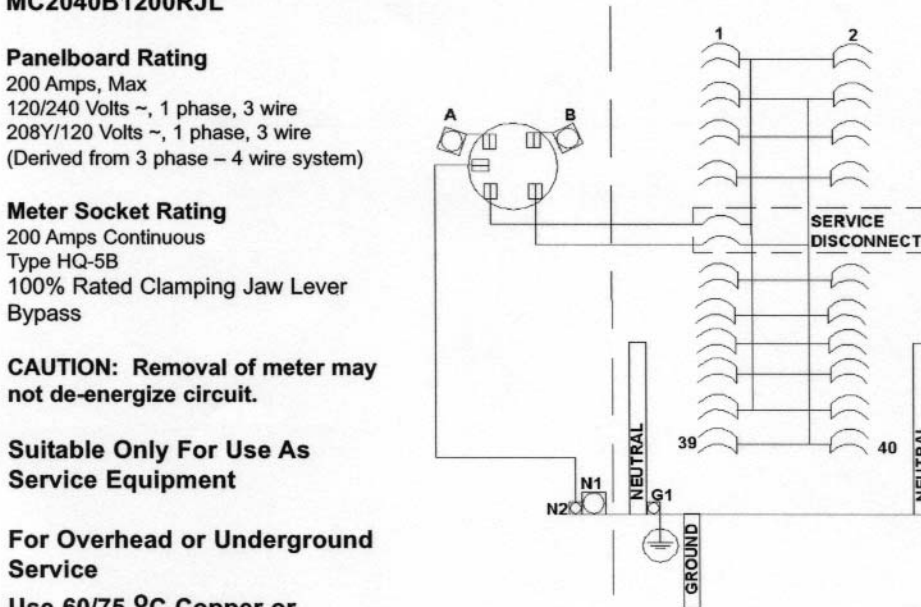

### General Information:

Circuit Breakers overload trip position is indicated by handle position midway between ON and OFF. To reset, move handle to OFF position then turn ON.  
For installation in accordance with all local Electrical codes and/or the National Electrical Code. ®

Terminal	Wire Size	Torque
A, B	350 kcmil - #6	375 lb. in.
N1	300 kcmil - #6	275 lb. in.
N2	#2-#14	50 lb. in.
G1	1/0-#14	120 lb. in.
Branch Breaker Terminals	See Markings on Breaker	
Neutral Bar/Ground Bar	#10 - #14 CU	20 lb. in.
	#10-#12 AL	20 lb. in.
	#8 #6	25 lb. in. 35 lb. in.
Ground Conductors only	(2) or (3) #14	20 lb. in.
	(2) #12-#10	20 lb. in.

### Accessories:

Filler Plate QF3  
Equipment Grounding Bars GB series

If hub is required, the catalog numbers listed below may be used on the top of this enclosure.

Trade size (in)	Catalog number
1 ¼"	S38597-2
1 ½"	S38598-2
2"	S38599-2
2 ½"	S38600-2

### Important

Do not spray or allow any petroleum based chemicals, solvents, or paint to contact interior components.  
® National Electrical Code is a registered trademark of the National Fire Protection Association.

E10703