


THIRD ANGLE PROJ.
REV 2
SHT 1
DWG NO. 11-B-2007-00

REVISIONS				
REV	C.N.	DESCRIPTION	DATE	BY
0	IA036		8-26-88	CK
1	IA924		5-24-91	RA
2	IB-908		4-20-95	RA

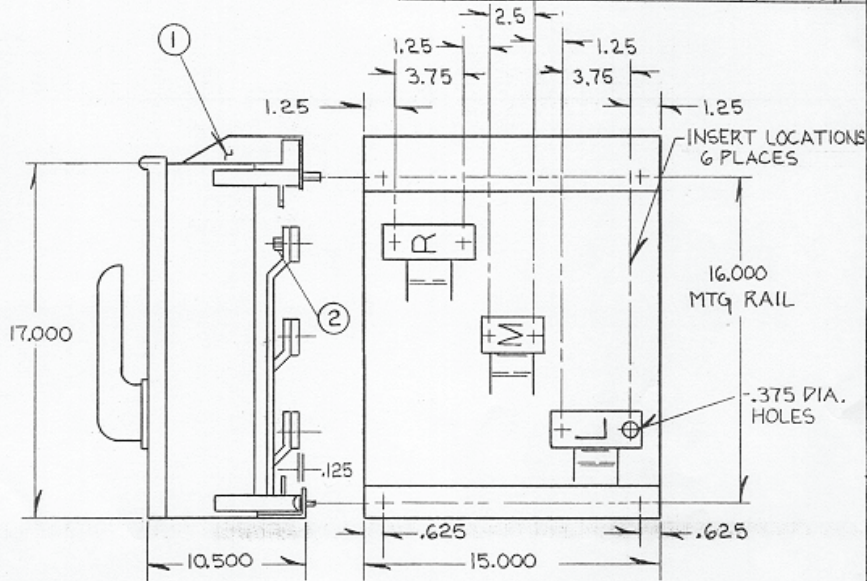

NOTES:

- 1) TORQUE VALUES: ALUM. 50 IN-LBS.; COPPER 72 IN-LBS.
- 2) FASTEN SWITCH TO Z-RAIL WITH CAPTIVE 1/4-20 SCREWS.

FOR FUSIBLE SWITCH CAT. NOS.	
V7H2205, V7H2206, V7H3205, V7H3206	
V7H2605, V7H2606, V7H3605, V7H3606	

! DANGER
 Hazardous voltage.
 Will cause death or serious injury.
 Keep out.
 Qualified personnel only.
 Disconnect and lock off all power before working on this equipment.

CONFIDENTIAL - PROPERTY OF SIEMENS INDUSTRY, INC.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
 TOLERANCES ARE NON-CUMULATIVE AND ARE AS FOLLOWS UNLESS SPECIFIED OTHERWISE.

.xx ± .030
 .xxx ± .015
 ANGULAR ± 2°
 DO NOT SCALE DRAWING

Siemens Industry, Inc.
 Building Technologies Division

VACU-BREAK MOUNTING
 F2 BRANCH BUS KIT
 15" SINGLE UNIT

DWN L. PAGE	DATE 3-23-88	SIZE	FSCM NO.	DWG NO.	REV
CHK <i>R</i>	DATE 7-19-88	A		11-B-2007-00	2
APVD <i>SH</i>	DATE 9-2-88	SCALE NTS		SHEET 1 OF 2	

FOR USE WITH 15" HIGH SINGLE UNITS (400A,600A)
 MOUNTED IN SPP/FPP/S5/F2/P5 PANELBOARDS (DEEP BOX).

Apvd SH	ITEM	DESCRIPTION	PC. NO.	QTY.	
5-12-95	1	FUSIBLE SWITCH	CAT. NO. *	1	
	2	1/4-20 X 1 1/4 SHWSW	11-1553-11	6	
	3	NEUTRAL LUG ASSEMBLY	12-B-2105-06	2	
	4				
	5				
	6				
	7				
	8				
	9	INSTRUCTION LABEL	31-1243-01	1	
	10	CARTON LABEL	15-A-1027-01	1	
	11	CARTON	48000989 ▲	1	
	12				
	13				
	14				
	15				
	16				
	17				
	18				
	19				
	20				
	21				
	22				
	23				
	24				
	25				
	26				
	27				
	28				
	29				
	30				
	31				
	32				
	33				
	34				
	35				
	36				
	37	* VACU-BREAK CAT. NO. F6150D			
	38	FOR FUSIBLE SWITCH CAT. NOS. V7H2205,			
	39	V7H2206, V7H3205, C7H3206, V7H3206, V7H2605,			
	40	V7H2606, C7H3605, V7H3606			
	41				
	42				
	43				
	44				
Revisions 0: 1B-908 1: IC-831A 04-12-04 2: IC-831B 07-24-06 3: IE-053A 1-10-07	Chk SH 5-12-95 By RAW 5-12-95	Confidential - property of Siemens Industry, Inc. Building Technologies Division	VACU-BREAK MOUNTING F2 BRANCH BUS KIT Title	11-B-2007-02 Dwg No. Sht. 1 Of 1	3 Rev.