

### Installation Instructions



**⚠ DANGER**  
**Hazardous Voltage.**  
 Will cause death, serious injury or substantial property damage.

Turn off power supplying this equipment before working inside.

**Note:** This instruction outlines the recommended general installation procedure. For installation by a qualified person, as defined by all local electrical codes and/or the National Electrical Code®.

**Step 1.** Turn off and lock off the power supplying the device before working inside.


**Step 2.** Remove 1/2" Keps Nuts and Washers from studs on each terminal bus and bus extension, as shown in Figure 1.

**Step 3.** Install Bus Extension on center studs of each terminal bus as shown in Figure 2. Secure Bus Extension with 1/2" Keps Nuts and Washers, torque 450-500 lb.-in.

**Step 4.** Install Lugs on each terminal bus and Bus Extension as shown in Figure 3. Secure Lugs with 1/2" Keps Nuts and Washers, torque 450-500 lb.-in.

**LUG KIT CONTENTS**

Wire Range:  
1/0-750 kcmil

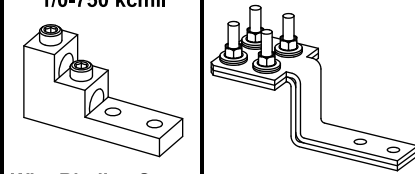

Wire Binding Screw  
Torque: 500 lb.-in.

Lug Kit No.	Wire Range	Lug Qty	Bus Extension Qty
LK18500N2C	1/0-500 kcmil CU	12	3
LK38500N2C	1/0-500 kcmil CU	16	4
LK18750N2A	1/0-750 kcmil AL	12	3
LK38750N2A	1/0-750 kcmil AL	16	4

