AB1834

THIRD ANGLE PROJ | REV 2 | SHT 1 | DWG NO 11-B-2006-00

REVISIONS				
REV	C.N.	DESCRIPTION	DATE	BY
0	1A036		8-26-88	R
1	1A924		5-24-91	RA
2	1B-908		4-20-95	RAW

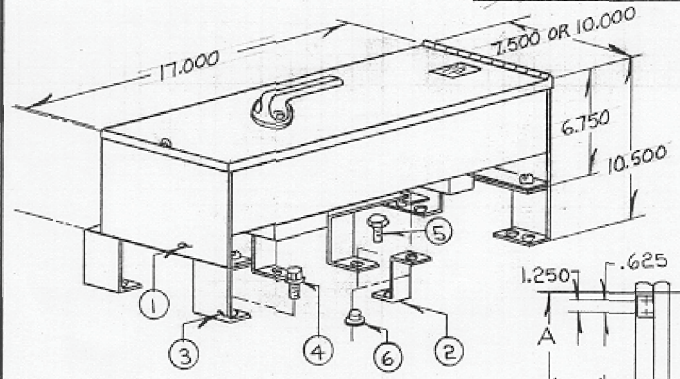

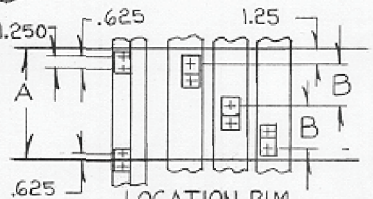

LOCATION PIM

A	B
7.500	2.500
10.000	3.750

NOTES:
1). WHEN CONNECTING SWITCH BUS TO BRANCH BUS, A 5/16 INSERT IS REQUIRED IN ALUM.(ONLY) BRANCH BUS.
2). WHEN MULTIPLE UNITS ARE INSTALLED, EACH MOUNTING BRACKET SUPPORTS ONE CORNER OF TWO (2) UNITS.

FOR FUSIBLE CAT. NOS.	
7 1/2" UNITS	10" UNITS
V7E2204	V7F3204 V7F2604 V7F3604

TORQUE VALUES
50 IN-LBS. AL.
72 IN-LBS. CU.

⚠ DANGER

Hazardous voltage. Will cause death or serious injury.

Keep out. Qualified personnel only. Disconnect and lock off all power before working on this equipment.

CONFIDENTIAL - Property of Siemens Industry, Inc.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
TOLERANCES ARE NON-CUMULATIVE AND ARE AS FOLLOWS UNLESS SPECIFIED OTHERWISE.
.XX ± .030
.XXX ± .015
ANGULAR ± 2°
DO NOT SCALE DRAWING

Siemens Industry, Inc.
Building Technologies Division

VACU-BREAK MOUNTING
▲ F2 BRANCH BUS KIT
7.500" & 10.000" SINGLE UNIT

DWN L.PAGE	DATE 3-22-88	SIZE A	FSCM NO.	DWG NO. 11-B-2006-00	REV 2
CHK [illegible]	DATE 7-19-88				
APVD SH	DATE 9-21-88	SCALE NTS		SHEET 1 OF 3	

Apvd SH 5-12-95	ITEM	DESCRIPTION	PC. NO.	QTY.
	1	FUSIBLE SWITCH	CAT. NO. *	1
	2	VACU-BREAK BRANCH BUS	11-7025-01	3
	3	VACU-BREAK MOUNTING BRACKET	11-6043-01	4
	4	1/4-20 X 3/8 SHWHSW	11-1553-02	8
	▲ 5	STRAP-BUS HARDWARE KIT	11-B-2022-05	1
	6			
	7	NEUTRAL LUG ASSEMBLY	12-B-2105-05	1
	8			
	9			
	10			
	11			
	12			
	13			
	14	INSTRUCTION SHEET	31-1242-01	1
	15	CARTON LABEL	15-A-1027-01	1
	16	CARTON	48000989	1
	17			
	18			
	19			
	20			
	21			
	22			
	23			
	24			
	25			
	26			
	27			
	28			
	29			
	30			
	31			
	32			
	33			
	34			
	35			
	36			
	37	* VACU-BREAK CAT. NO. F671D		
	38	7 1/2" UNITS – FOR FUSIBLE SWITCH CAT. NOS.		
	39	V7E2204		
	40	10" UNITS – FOR FUSIBLE SWITCH CAT. NOS.		
	41	V7F3204, V7F2604, V7F3604		
	42			
	43			
	44	MERCHANDISE KIT NO. F671D		

Revisions D: 1B-908 4:1E-166B 12-11-09
1:1C-831A 04-12-04
2:1C-831B 07-24-06
3:1E-053A 1-10-07

Chk SH 5-12-95

By RAW 5-12-95

Confidential – property of Siemens Industry Norcross, GA Building Technologies Division	VACU-BREAK MOUNTING COPPER BRANCH BUS F2 (Title)	11-B-2006-03 Dwg No.	4 Rev.
		Sht. 1 Of 1	

FOR USE WITH 7.5" AND 10" HIGH SINGLE UNITS (200A) MOUNTED IN SPP/FPP/S5/F2/P5 PANELBOARDS (DEEP BOX).

Siemens Industry, Inc.
Building Technologies Division
Norcross, GA

CAT. NO. F671D