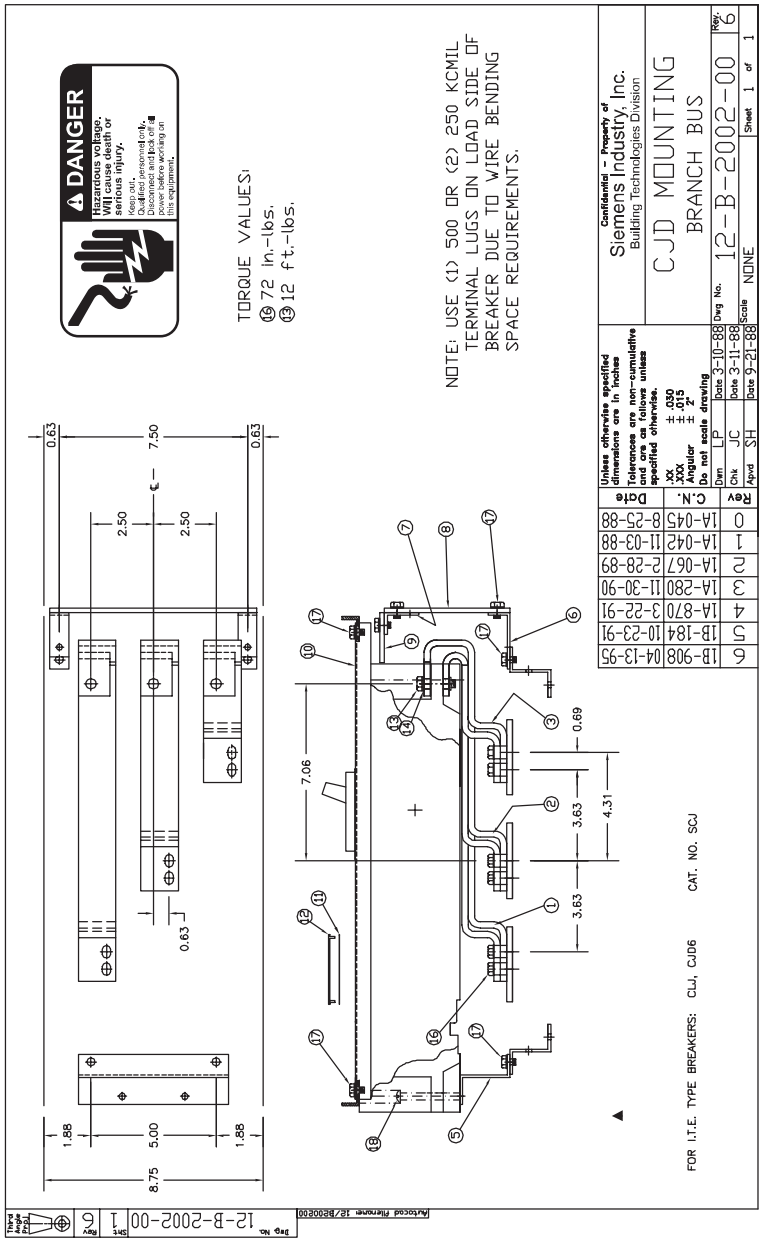


FOR USE WITH CJD6 FRAME BREAKERS MOUNTED IN SPP/FPP/S4/F1/P4 PANELBOARDS (SHALLOW BOX).

| Apvd PM 11-30-90 | ITEM | DESCRIPTION | PC. NO. | QTY. |
|---|---|---|---|---|
| | 1 | A PHASE BRANCH BUS | 12-B-4008-03 | 1 |
| | 2 | B PHASE BRANCH BUS | 12-B-4008-04 | 1 |
| | 3 | C PHASE BRANCH BUS | 12-B-4008-05 | 1 |
| | 4 | | | |
| | 5 | MOUNTING BRACKET | 15-B-3022-01 | 1 |
| | 6 | BARRIER CLIP | 11-B-3007-02 | 2 |
| | 7 | BARRIER CLIP | 11-B-3007-01 | 2 |
| | 8 | LOAD BARRIER | 11-B-4501-01 | 1 |
| | 9 | LOAD BARRIER | 11-B-4501-03 | 1 |
| | 10 | COVER PLATE | 12-6194-02 | 1 |
| | 11 | CIRCUIT I.D. CARD | 11-7505-01 | 1 |
| | 12 | CARD HOLDER | 11-7506-01 | 1 |
| | 13 | 5/16-18 X 1 1/4 HHMS | 11-1566-07 | 3 |
| | 14 | 5/16 LOCK WASHER | 11-1618-04 | 3 |
| | 15 | | | |
| | 16 | STRAP-BUS HARDWARE KIT | 11-B-2023-05 | 1 |
| | 17 | 1/4-20 X 3/8 SHWHSW | 11-1553-02 | 14 |
| | 18 | 1/4-20 X 2 1/2 SRHMS | 11-1542-13 | 2 |
| | 19 | | | |
| | 20 | | | |
| | 21 | | | |
| | 22 | | | |
| | 23 | | | |
| | 24 | NEUTRAL LUG ASSEMBLY | 12-B-2105-06 | 1 |
| | 25 | | | |
| | 26 | | | |
| | 27 | | | |
| | 28 | INSTRUCTION SHEET | 31-1208-01 | 1 |
| | 29 | CARTON LABEL | 15-A-1027-01 | 1 |
| | 30 | CARTON | 48001057 ▲ | 1 |
| | 31 | | | |
| | 32 | | | |
| | 33 | | | |
| | 34 | | | |
| | 35 | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | FOR I.T.E. TYPE BREAKERS: | | |
| | | CLJ, CJD6 | | |
| | | | | |
| | | | | |
| | | MERCHANDISE KIT NO. SCJ | | |

Revisions 0: 1A-280 4-12-04; 1: 1A-870 3-22-91; 2: 1B-908 5-8-95; 3: 1C-831A 4-12-04; 4: 1C-831B 7-31-06

Chk SH 11-30-90

By MC 11-20-90

| Confidential – property of Siemens Industry, Inc. Building Technologies Division | CJD BREAKER MOUNTING S4, BRANCH BUS COPPER (Title) | 12-B-2002-03 Dwg No. | 4 Rev. |
|---|---|---|---|
| | | Sht. 1 Of 1 | |



Siemens Industry, Inc.
Building Technologies Division
Norcross, GA

**CAT. NO. SCJ**