


**IF IN DOUBT ASK  
DO NOT SCALE**

Relay Earthing

Terminal B28 of the PSU should be earthed by a direct connection to the device case earth stud.

The device case earth stud should be solidly earthed by a direct connection to the panel earth.


Terminal contacts internal to case assembly close when device is withdrawn from case.

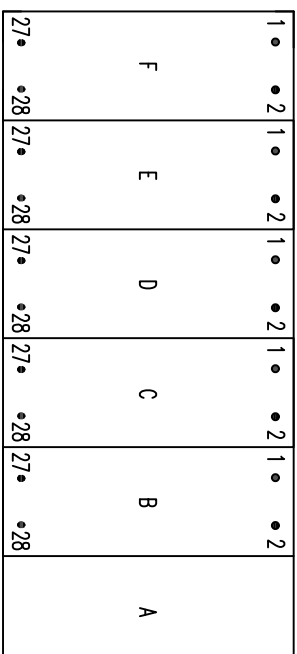

VIEWED FROM REAR

Notes – Ethernet Options

Device will be fitted with either 2 x electrical (RJ45) or 2 x optical (LC) ethernet ports.

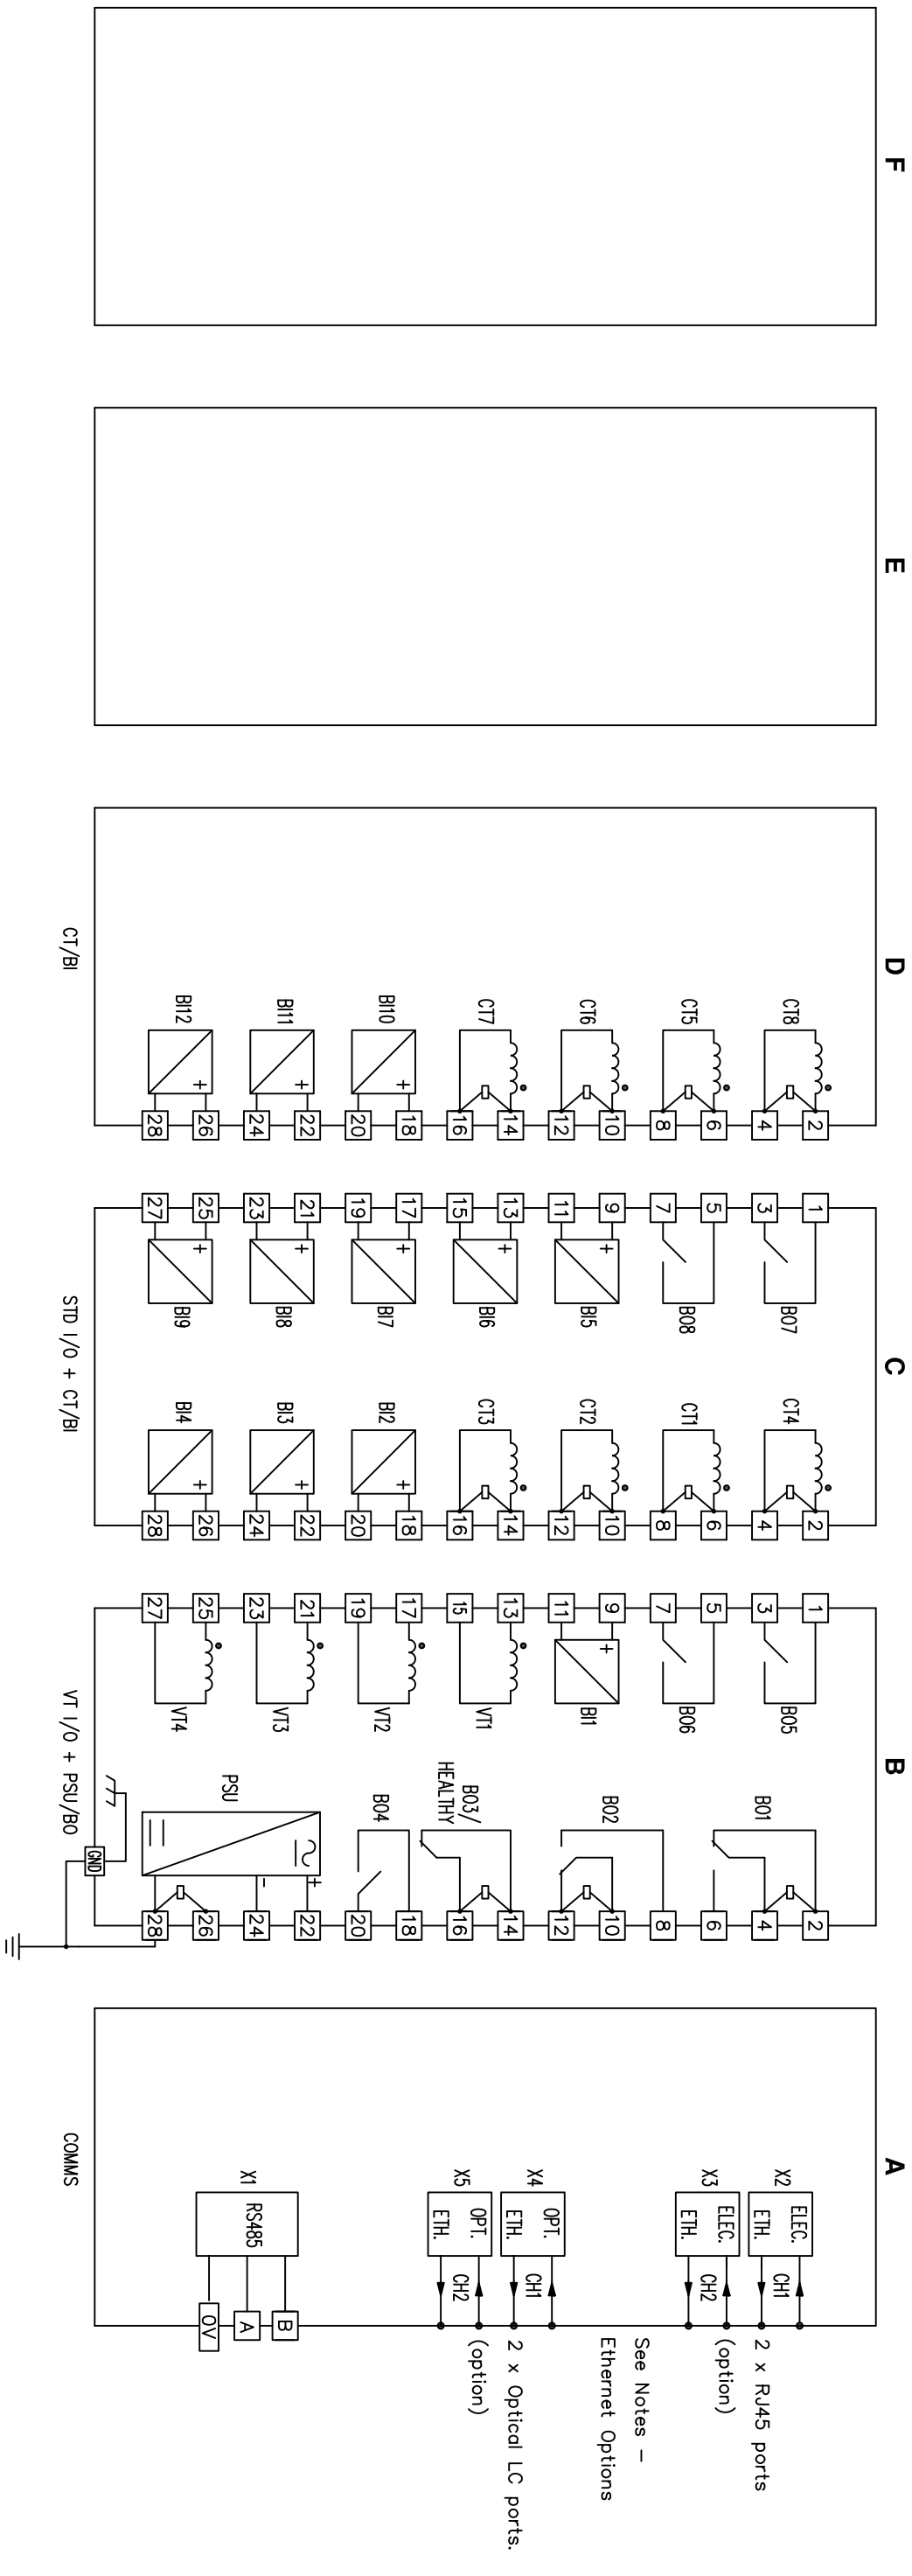

ABBREVIATIONS	
CT	CURRENT TRANSFORMER
VT	VOLTAGE TRANSFORMER
BI	BINARY INPUT
BO	BINARY OUTPUT
GND	GROUND
ELEC	ELECTRICAL
OPT	OPTICAL
ETH	ETHERNET
STD I/O	STANDARD INPUT/OUTPUT
PSU	POWER SUPPLY UNIT (AUXILIARY)

**EU EXPORT CONTROLS**

**ECCN: N**

**AL: N**

This document is not Export Controlled unless sending to Critical Countries.

Finish:	–	Title:	REAR TERMINAL CONNECTIONS – 7SR5421–1AAx6–0AA0	Original Scale:	NTS	Dwg No.:	2518W50027
Treatment:	–		8CT, 4VT, 12BI, 8B0			Similar Articles: –	
Drawn:	J. SPOWART	Checked:	K. H.	Approved:	N. CAMPBELL	Date:	27/08/19
Copyright © 2019		A3		SIEMENS PLC		Hebburn	

ISSUE	DATE	CHANGE
1	27/08/19	NOTED