


LOOKING ON FRONT OF RELAY

2112W50079

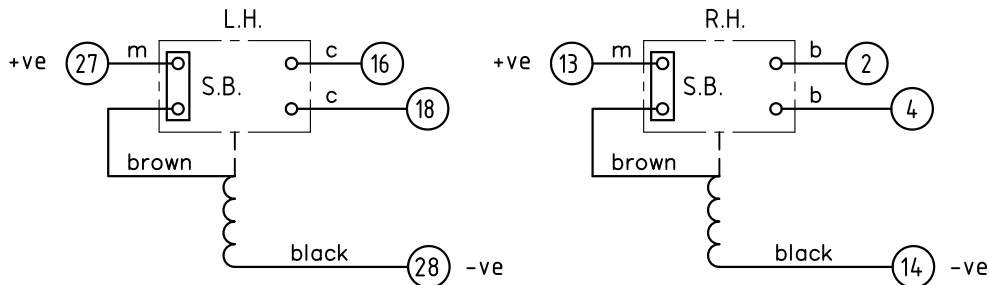

**FOR INTERNAL USE ONLY  
UNCONTROLLED COPY  
NOT SUBJECT TO UPDATE**


ASSEMBLY WIRES USED		
b	2107B10002	2 OFF
c	2107B10003	2 OFF
m	2107D10181	2 OFF

**KEY**


- make contact
- break contact
- c/o contact
- ext. conn
- plug bridge - shorting
- metering point
- 5Kv barrier
- test socket - shorting
- plug & socket

COIL	2112G20019	2112G20020	2112G20022	2112G20023	2112G20026	2112G20029
Vdc	24	30	50	60	125	240
CONTACT CONFIG.	OUTPUT CONTACT PAIR / TERMINAL No.					
R.H. →	1-3	2-4	5-7	6-8	9-11	10-12
L.H. →	15-17	16-18	19-21	20-22	23-25	24-26
1M 1SB	/	M	/	/	/	/
1B 1SB	/	B	/	/	/	/

NOTE: WHEN RECTIFIER IS SPECIFIED COIL CONNS AND ADDITIONAL WIRES ARE AS SHOWN.

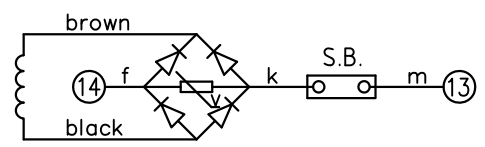


FRAME REFERENCE: E4FS09.  
 FRAME TERMINAL BLOCK ASSY: -  
 ASSEMBLY INSTRUCTIONS: -  
 TYPICAL ASSEMBLY DRAWING 2995G10032.  
 AT INDICATED POSITIONS FIT AS FOLLOWS:  
 T - FIT TRIP ISOLATION CONTACT 2995B10053  
 S - FIT STANDARD CONTACT 2995B10054  
 SECURE CONTACTS USING FIXING SCREW 2109F99009.  
 POSITIONS SHOWN BLANK ARE UNUSED

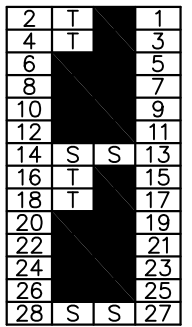

VIEW FROM NUMBERED SIDE OF BLOCK

OUTER TERMINAL BLOCK ASSY: -  
 ASSEMBLY INSTRUCTIONS: -  
 TYPICAL ASSEMBLY DRAWING 2995G10029.  
 AT INDICATED POSITIONS FIT AS FOLLOWS:  
 S - FIT STANDARD CONTACT 2995B10051  
 HC - FIT 'HEAVY CURRENT' KIT 2995G10030  
 WHERE IS SHOWN FIT CT SHORTING KIT 2995G10031  
 POSITIONS SHOWN BLANK ARE UNUSED.  
 ALL POSITIONS FIT SCREW 2106F12506.

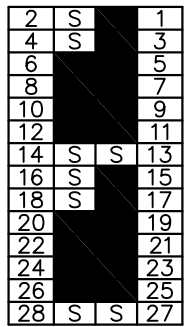

VIEW FROM INSIDE FACE

Copyright © 2015 VA TECH Reyrolle Ltd. Hebburn

Title. T.B. AND W.D. FOR AR212SB 2 CONTACT RELAYS IN EPSILON E4 CASE.			First used on:		
5 N.C 19/06/15 MN112/3882			Similar Articles:		
4 RDW 10/07/12 MN111C/3479			Supersedes:		
3 RDW 16/01/04 MN112/2606			Drg.No.		
2 12/04/00 MN995/09			2112W50079		
ISSUE	DATE	MOD.No.	VA TECH Reyrolle AUTOMATION, CONTROL & PROTECTION		Original Scale.
DRAWN: A.LAW.	CHECKED:	APPROVED: R.D.WATSON	DATE: 17/07/02	IE:	OPS: