

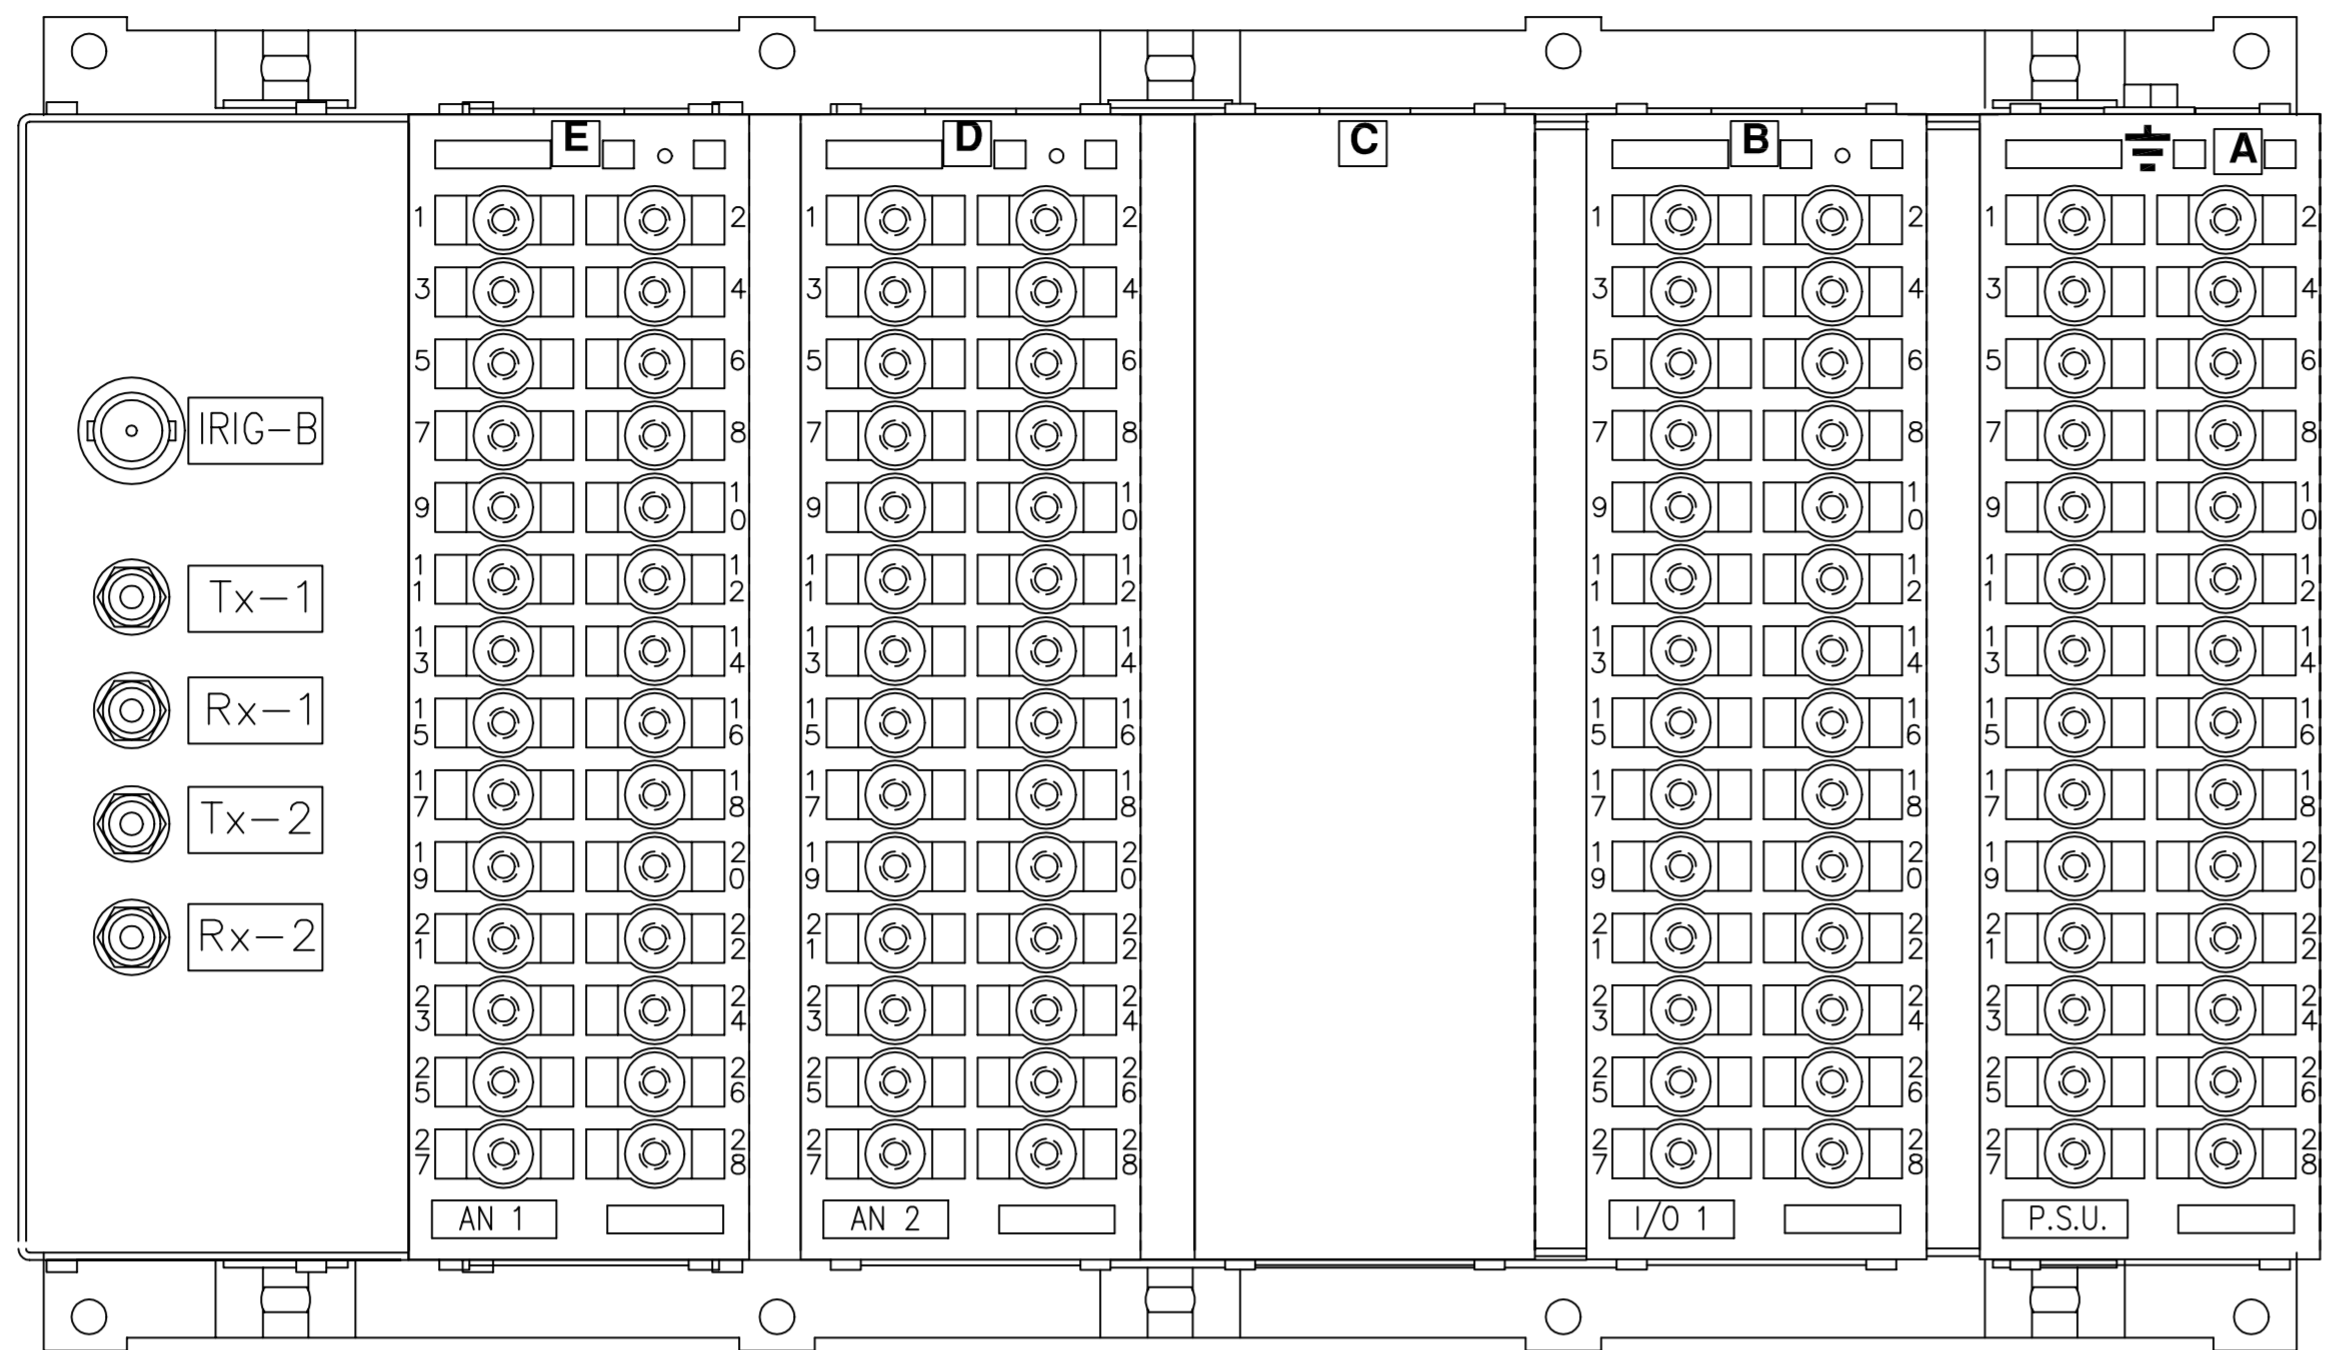


IF IN DOUBT ASK  
DO NOT SCALE


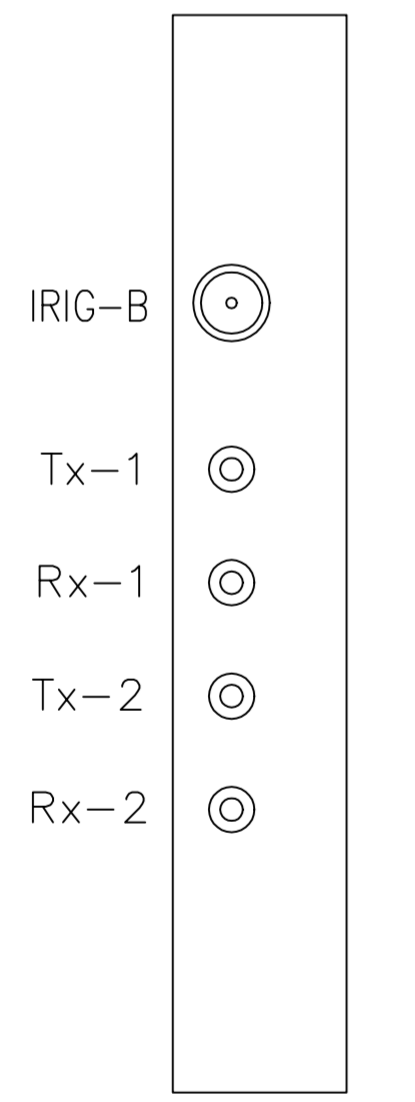


RELAY VIEWED FROM REAR

NOTES  
 1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.  
 SUPPLIER AMP CABLE SIZE  
 AMP 342103 0.25-1.6 SQ MM  
 AMP 342143 1.0-2.6 SQ MM.  
 OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.  
 2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).  
 3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

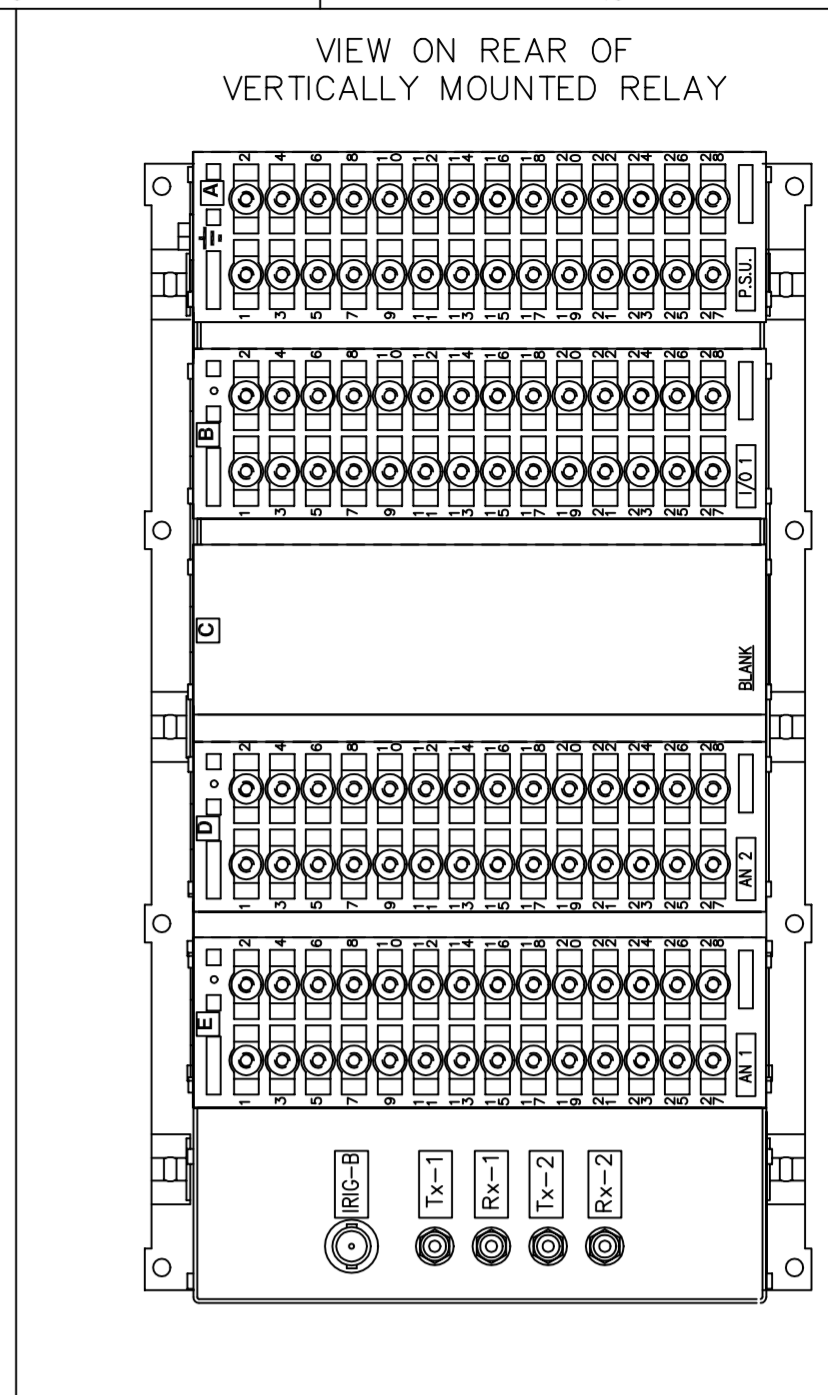

Controller Module  
(SEE NOTE 3)

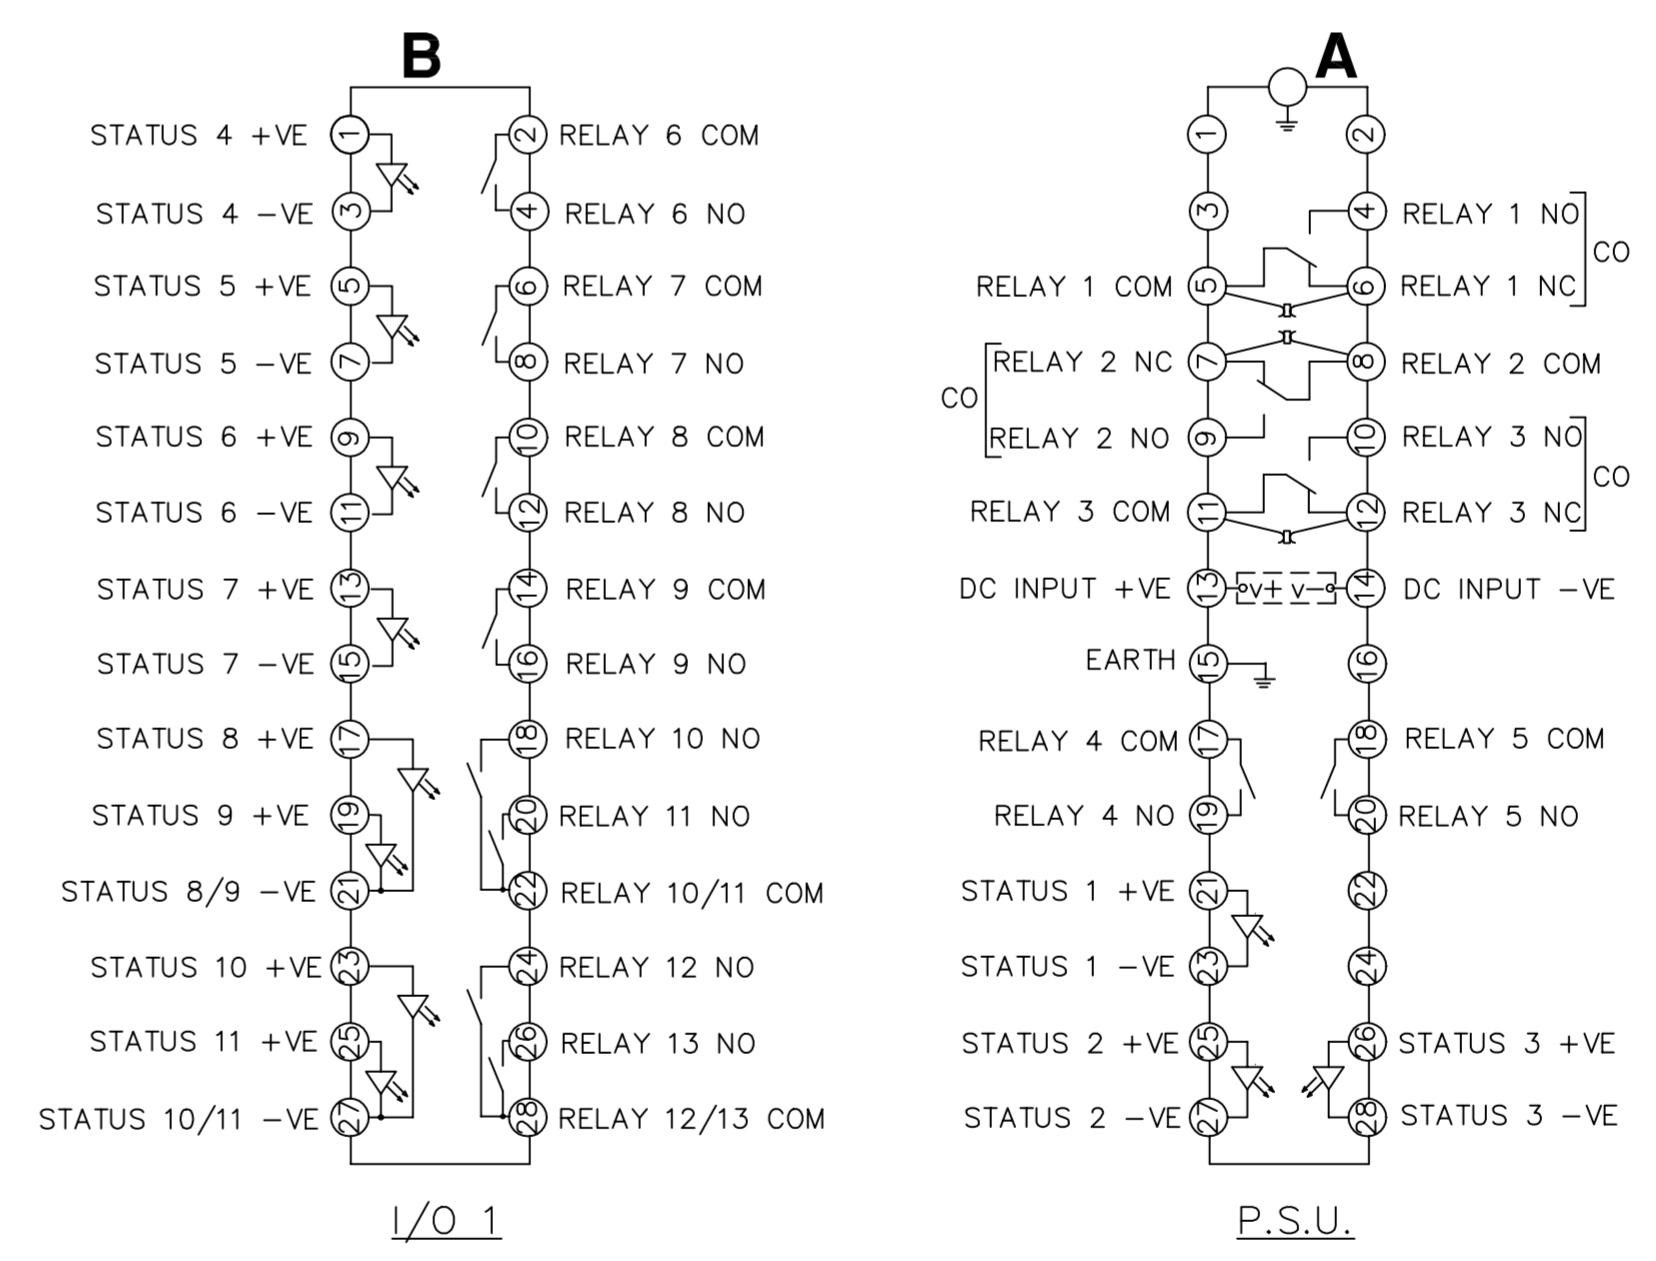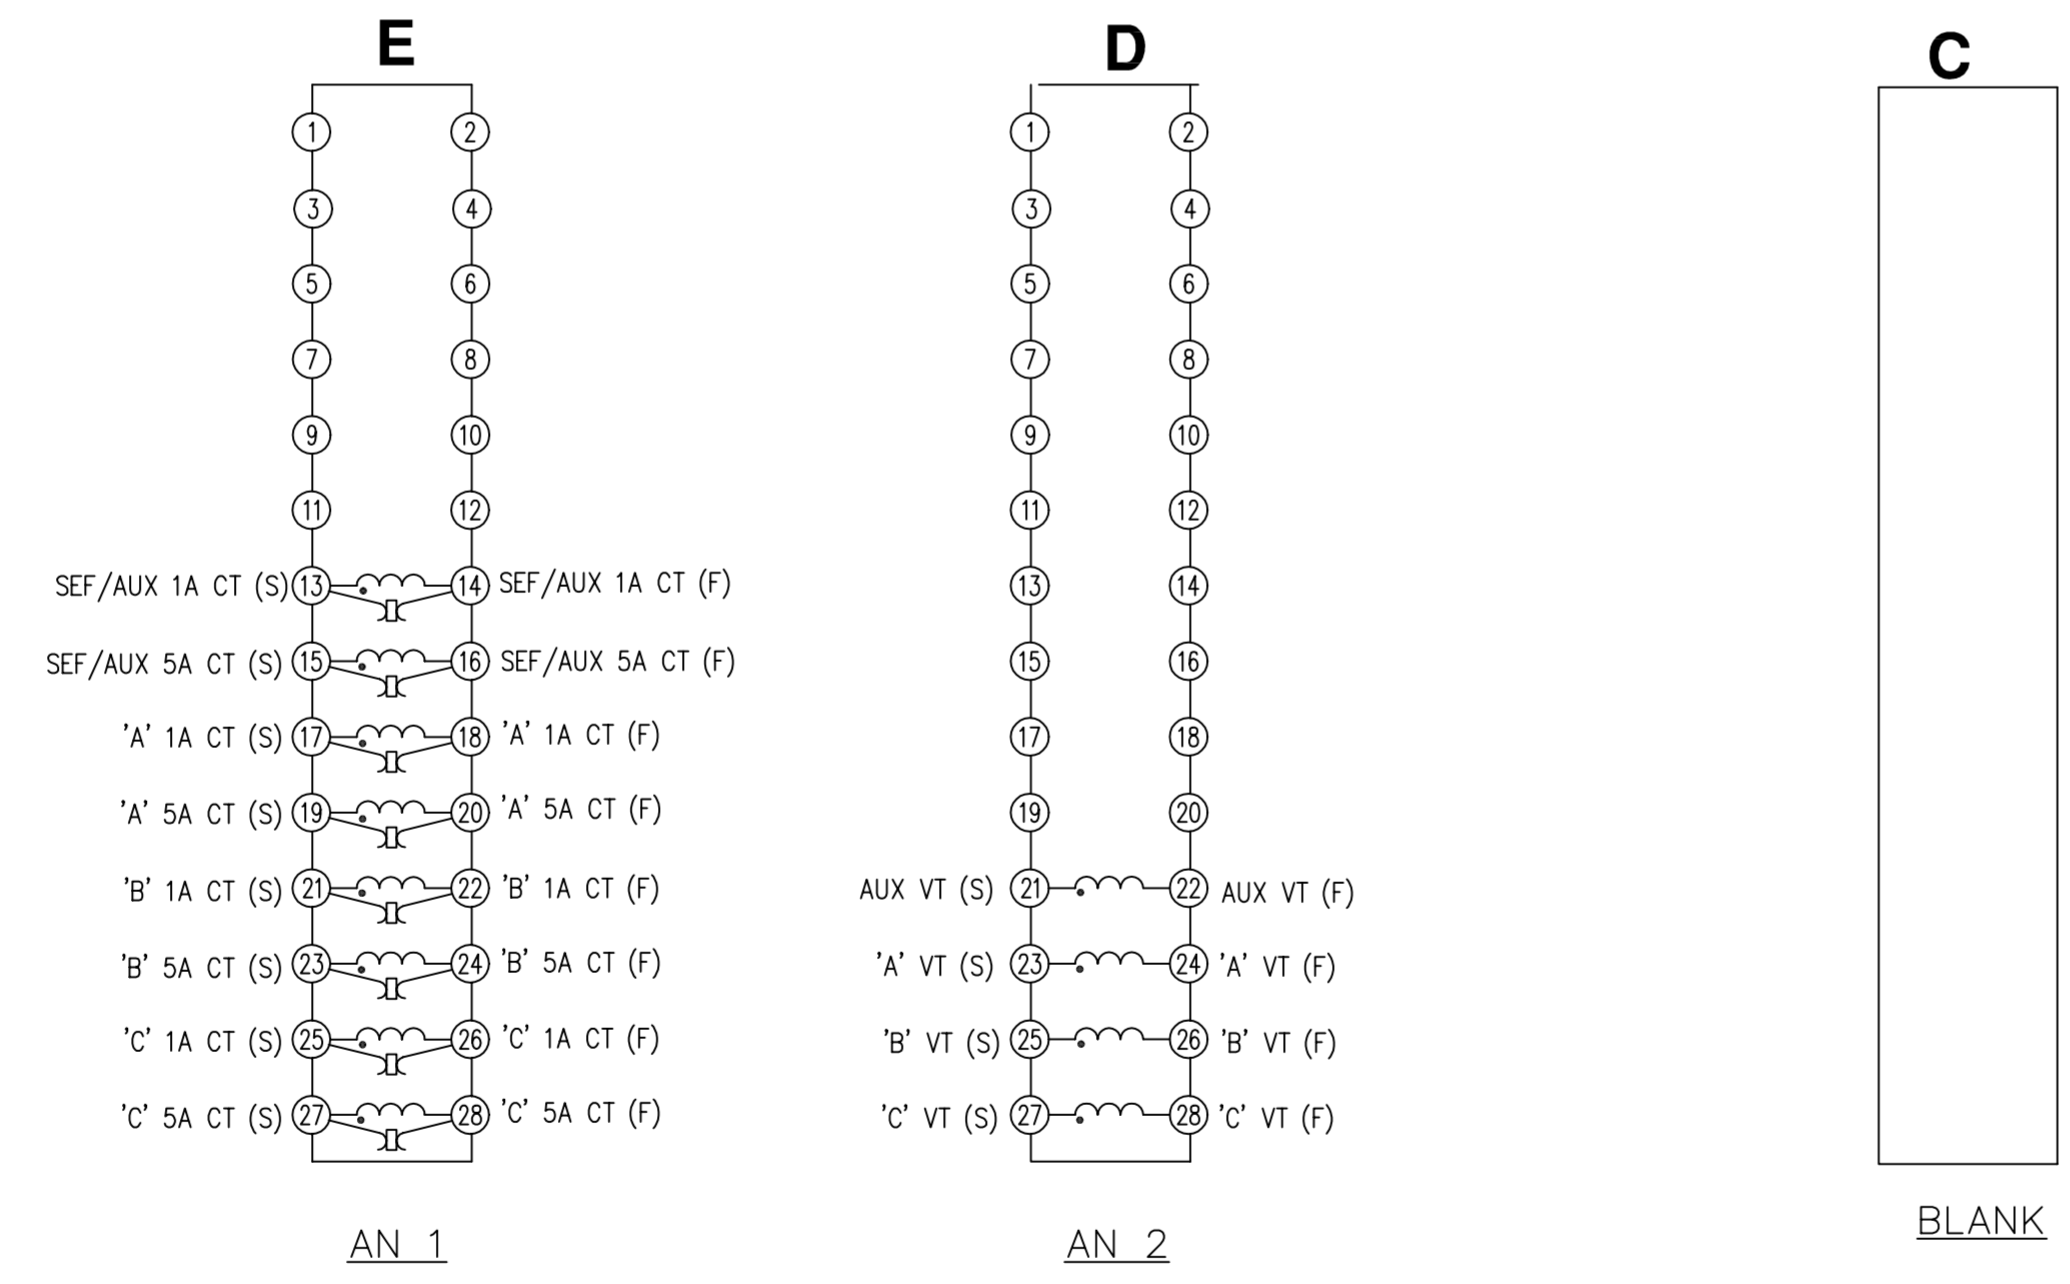

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

NOT SUBJECT TO UPDATE  
ONCE COPIED / PRINTED  
OR DOWNLOADED

MATERIAL:  
 Dimensions in millimetres : Surface texture in micrometres.  
 Machine where marked ✓  
 For explanation of dimensions, tolerances, notes etc. see B.S.308.  
 Limit on untoleranced unmachined dimensions ±  
 Limits on untoleranced machined dimensions to B.S.4500;  
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;  
 over 6 to 30±0.2; over 120 to 315±0.5;  
 General unmachined angular tolerance ±

Drawn: RDW	Checked: RDW	Approved: RD. WATSON	Date: 25/05/04	IE	OPS	PCP	Purch.Spec. TQ	EAC	CE	STD	A1
------------	--------------	----------------------	----------------	----	-----	-----	----------------	-----	----	-----	----

Copyright © 2004 VATECH REYROLLE ACP Ltd. Hebburn

1 RDW	25/05/04	MNS13/2647 MM
PI	04/02/04	CHANGE
ISSUE	DATE	NOTED

First used on:  
 Similar Articles:  
 Supersedes:  
 Original Scale: Drg. No. 2513W11004  
 NTS

ABBREVIATIONS  
 CT-CURRENT INPUTS  
 VT-VOLTAGE INPUTS  
 SI-STATUS INPUTS  
 CO-CHANGE OVER OUTPUT CONTACTS  
 NO-NORMALLY OPEN OUTPUT CONTACTS  
 NC-NORMALLY CLOSED OUTPUT CONTACTS

Finish:  
 Treatment:

Title:  
 TERM IDENT & WIRING DIAGRAM FOR MODULAR 2 RELAYS  
 (4CT,4VT,11SI,3CO,10NO) E12 CASE

VATECH REYROLLE  
 AUTOMATION, CONTROL & PROTECTION