


- NOTES**
- 1) TERMINALS RECOMMENDED ARE PRE-INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PLOG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.
 - 2) FOR OUTLINE & PANEL DRILLING, SEE 2995X10004 (A4).
 - 3) CONNECTIONS TO THIS COMMUNICATIONS FACILITY IS BY SCREENED, TWISTED PAIR CABLE. ON SITE WHEN WIRING OTHER FACILITIES ENSURE THAT THESE TERMINALS ARE NOT OBSCURED BY OTHER WIRE RUNS.
 - 4) CONTACTS SHOWN THUS ARE INTERNAL RELAY CASE ASSEMBLY CONTACTS AND CLOSE WHEN THE RELAY CHASSIS IS WITHDRAWN FROM THE CASE.
 - 5) FOR THE RELAY CASE ASSEMBLY SEE 2436G40049



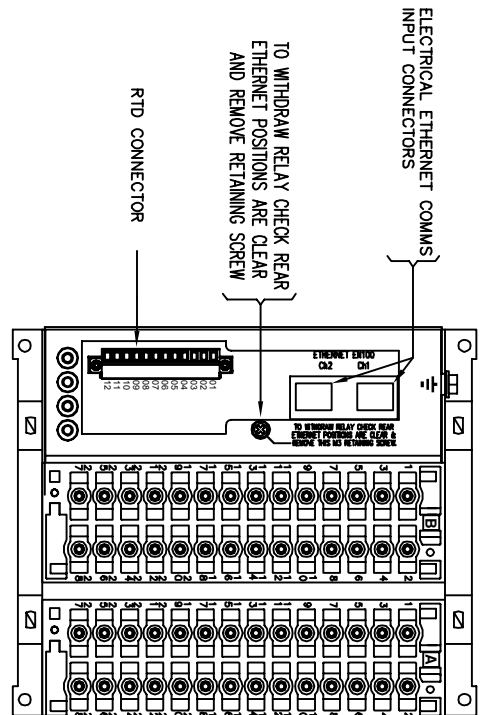


ABBREVIATIONS

I-CURRENT INPUTS
V-VOLTAGE INPUTS
BI-BINARY INPUTS
BO-BINARY OUTPUTS
CO-CHANGE OVER BINARY OUTPUT CONTACTS
NO-NORMALLY OPEN BINARY OUTPUT CONTACTS
NC-NORMALLY CLOSED BINARY OUTPUT CONTACTS

COMMUNICATIONS IDENTIFICATION

COM1	RS485 (ON BLOCK 'B' TERMINALS 14,16,18 & 20)
COM2	USB TYPE 'B' PORT (ON RELAY FRONT LABEL)
COM3	ETHERNET(2) PORTS (ON REAR COMMS MODULE)

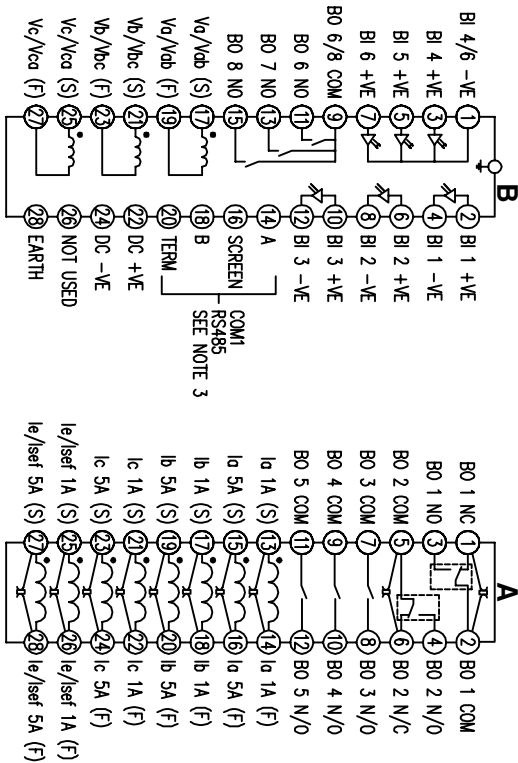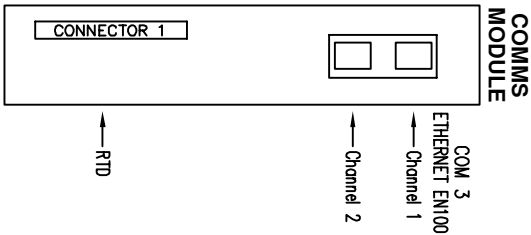

FOR INTERNAL USE ONLY
UNCONTROLLED COPY
NOT SUBJECT TO UPDATE

UNSPECIFIED TOLERANCES UNLESS STATED	
COUPLER	TOLERANCE
0-4.0	M0.1
6-15.0	M0.2
16-25.0	M0.3
26-50.0	M0.5
51-75.0	M0.7
76-100.0	M1.0

Rev.	1/A	Change		Date		Name	AMAR
DRAWING RELEASED						AMAR	
FINISH						Siemens Ltd	
Material		NTS		Material		Material	
Title						TERMINAL ID & WIRING DIAGRAM FOR 7SR17 4CT+3VT+8BI+8BO(2CO+6NO), ELEC ETH(2), 4 RTD	
DocuNo		2436W40077		DocuNo		2436W40077	
Rev.		7SR17		Rev.		1/A	
1 of 1							