

SIEMENS

Ingenuity for life



Flexible Engineering – Modeling the System with the IEC 61850

www.siemens.com/siprotec5

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

APN-019, Edition 1

Content

1	Flexible Engineering – Modeling the System with the Options of IEC 61850	3
1.1	Summary	3
1.2	Introduction.....	3
1.3	Task.....	4
1.4	Solution.....	5
1.5	Conclusion.....	10

1 Flexible Engineering – Modeling the System with the Options of IEC 61850

1.1 Summary

For the complete conversion of a system to IEC 61850 it is important that the modeling options of the standard can be used. In particular when assigning the IEC 61850 names for user-defined information and functions, flexibility is needed in order to make the modeling the customer desires actually visible on the interface. With the "Flexible Engineering" concept DIGSI 5 offers the solution.

1.2 Introduction

The IEC 61850 standard provides a large number of logical nodes (LN) in part 7-4. These nodes describe the functions made available by a protection device or bay controller. In this context we differentiate between integral device functions and functionality configured by the user. The first category comprises mainly protection functions but also e.g. the synchrocheck. These are type-tested functionalities the quality of which the manufacturer guarantees. These functions are assigned to the LN classes P (Protection) and R (Protection-related Functions), e.g. PDIS for distance protection or RSYN for synchrocheck. A fixed, unchangeable assignment of the function with its information to the standardized logical node is essential here for the sake of clarity.

The second category comprises the other LN classes. These describe functions that are not permanently installed in the devices but are created by engineering or connection to external circuits. Typical examples are the nodes in the LN class S (Sensors and Monitoring), e.g. SIMG.

Although "circuit breaker" and "disconnecter" switching devices are no functions in the protection device, modeling of control, interlocking and physical switch is performed so that these devices belong to the first category and are permanently modeled as XCBR (circuit breakers) or XSWI (disconnectors).

This note describes how functions and information of the second category can be modeled freely with DIGSI 5 so that you can use the IEC 61850-7-4 description language for your system.

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

1.3 Task

With a SIPROTEC 5 device three gas-filled compartments of a gas-insulated switchgear are monitored. For this purpose the gas pressure is monitored using gas sensors that transmit the values measured to the device via 20mA interface. If a pre-defined limit value is reached an alarm is issued per gas compartment. Additionally, a group alarm is generated consisting of the OR logic operation of all individual gas compartment alarms.

For transmitting the warning messages via the IEC 61850 interface the logical node "SIMG" shall be used, which is provided for this purpose in the IEC 61850-7-4. (Description: Insulation Medium Supervision (Gas)).

The logical node is described in part 7-4 of the IEC 61850 standard (see Figure 1). Like the Common Logical Node Class it also possesses the "mandatory data objects" (mode, behaviour, health). In addition, the SIMG logical node has the data object „InsAlm“ (Insulation alarm) of the SPS type (Insulation gas critical, refill medium). This data object shall be supplied with the group alarm.

Additionally three measured values for gas pressure, gas density and gas temperature shall be transmitted.

SIMG class				
Attribute Name	Attr. Type	Explanation	T	M/O
LNNName		Shall be inherited from Logical-Node Class (see IEC 61850-7-2)		
Data				
Common Logical Node Information				
		LN shall inherit all Mandatory Data from Common Logical Node Class		M
EEHealth	INS	External equipment health		O
EENName	DPL	External equipment name plate		O
Measured values				
Pres	MV	Isolation gas pressure		O
Den	MV	Isolation gas density		O
Tmp	MV	Isolation gas temperature		O
Status Information				
InsAlm	SPS	Insulation gas critical (refill isolation medium)		M
InsBlk	SPS	Insulation gas not safe (block device operation)		O
InsTr	SPS	Insulation gas dangerous (trip for device isolation)		O
PresAlm	SPS	Isolation gas pressure alarm		C

Figure 1: Specifications of IEC61850-7-4 for SIMG node (excerpt)

M=Mandatory, O=Optional; C=Conditional

1.4 Solution

The basis is a bay controller of the 6MD85 type with two transducer modules ANAI (each 4 x 20mA) for data acquisition, see Figure 2

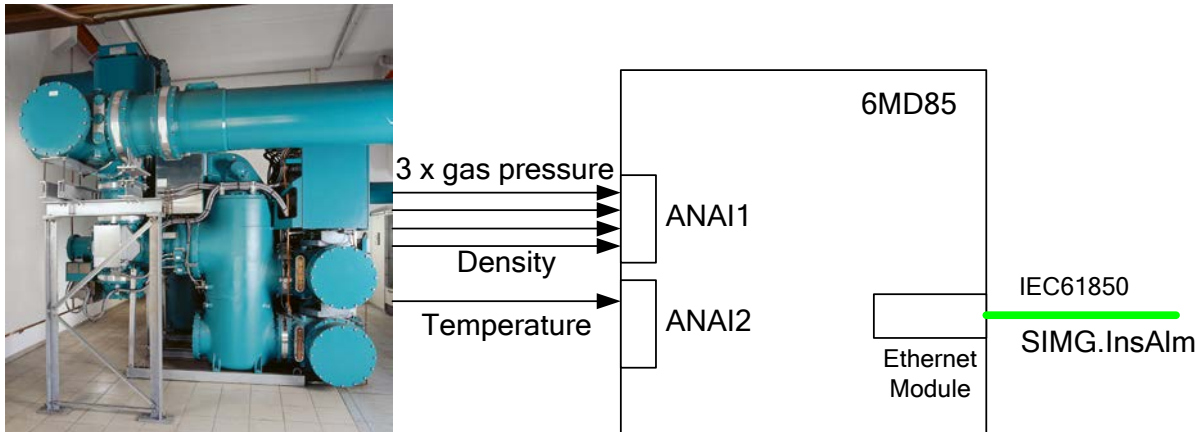


Figure 2: Acquisition of the measured values from a gas-insulated switchgear and transmission to IEC61850

After creating the two ANAI modules in the DIGSI hardware configuration the 8 channels for 20mA measured values are available in the "Information routing" editor. The three warning messages for the violation of the gas pressure limit are created in the CFC.

Below it is shown how the required function SF 6 Alarms is generated as an IEC 61850 element and adapted to the specific needs of the user.

To this purpose two editors are provided in DIGSI 5, enabling two different views of the same SIPROTEC 5 object structure. The "Information routing editor" shows the individual information from the user point of view whereas the "IEC 61850 structure editor" enables the IEC 61850 view and the adjustment of its structure to the customer requirements.

In a first step, the new customer-specific structures are created in the DIGSI 5 "Information routing editor". The library provides the appropriate function groups (FG), functions blocks (FB) and signals for this purpose. These elements can easily be moved into the routing matrix by Drag&Drop.

Figure 3 and Figure 4 show the new, user-defined function group in the "Information routing editor" and in the "IEC 61850 structure editor". The newly generated function group creates a new logical device UD1 in the IEC 61850 structure view that later on will be renamed "SF6_Alarming".

The structure is now completed by assigning a function block and further signals according to the structure of the logical node. See the representation in "Information routing" and "IEC 61850 structure editor" (Figure 5 and Figure 6)

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

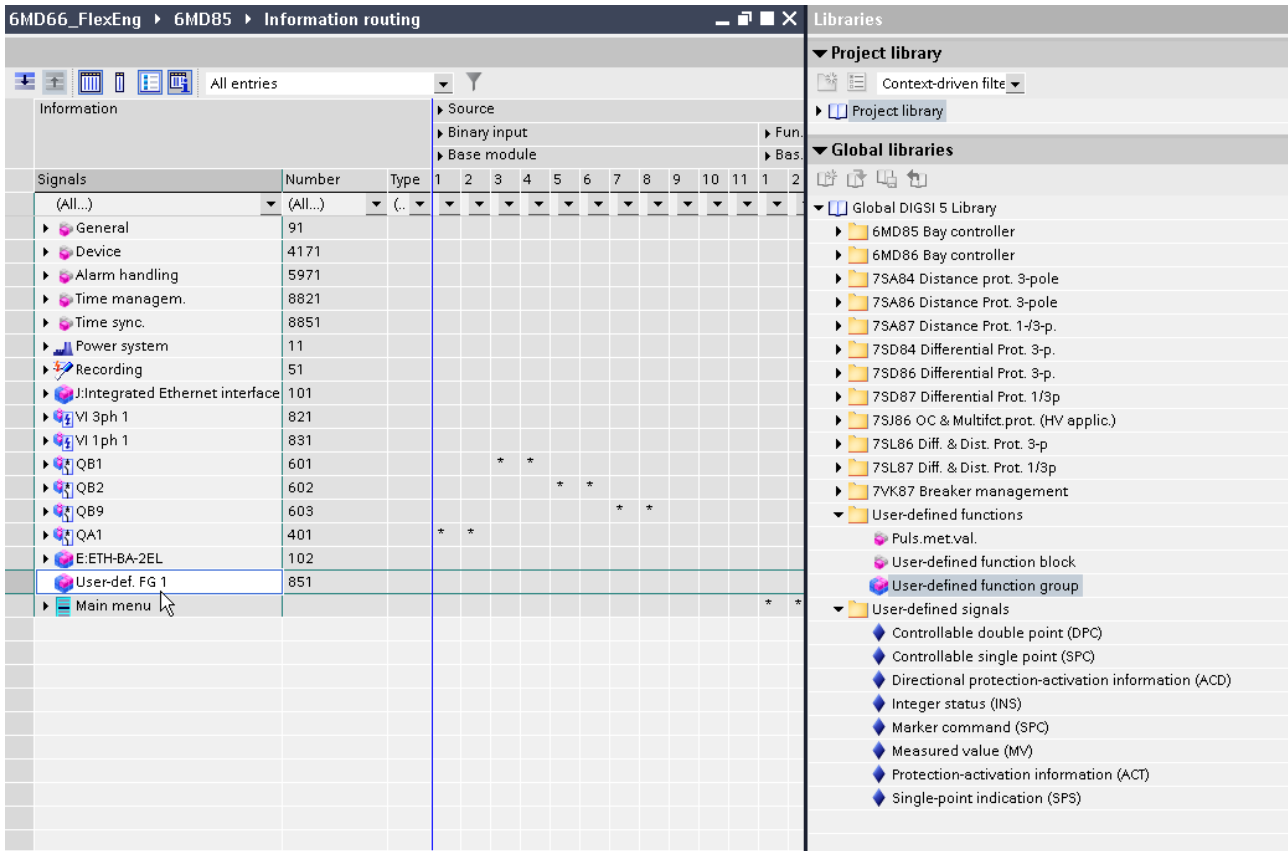


Figure 3: Creating a new function group in the "Information routing editor"

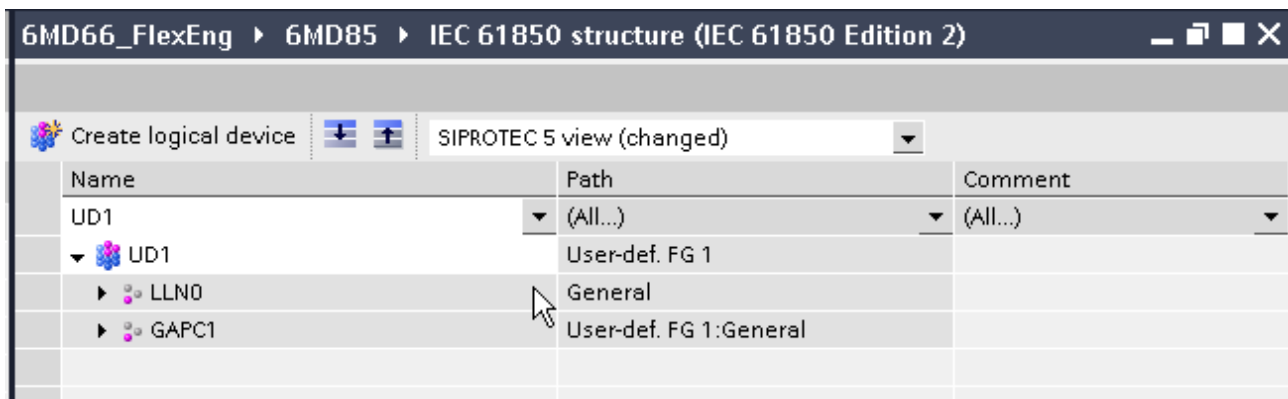


Figure 4: Representation of the user-defined function group as a logical device in the "IEC 61850 structure editor"

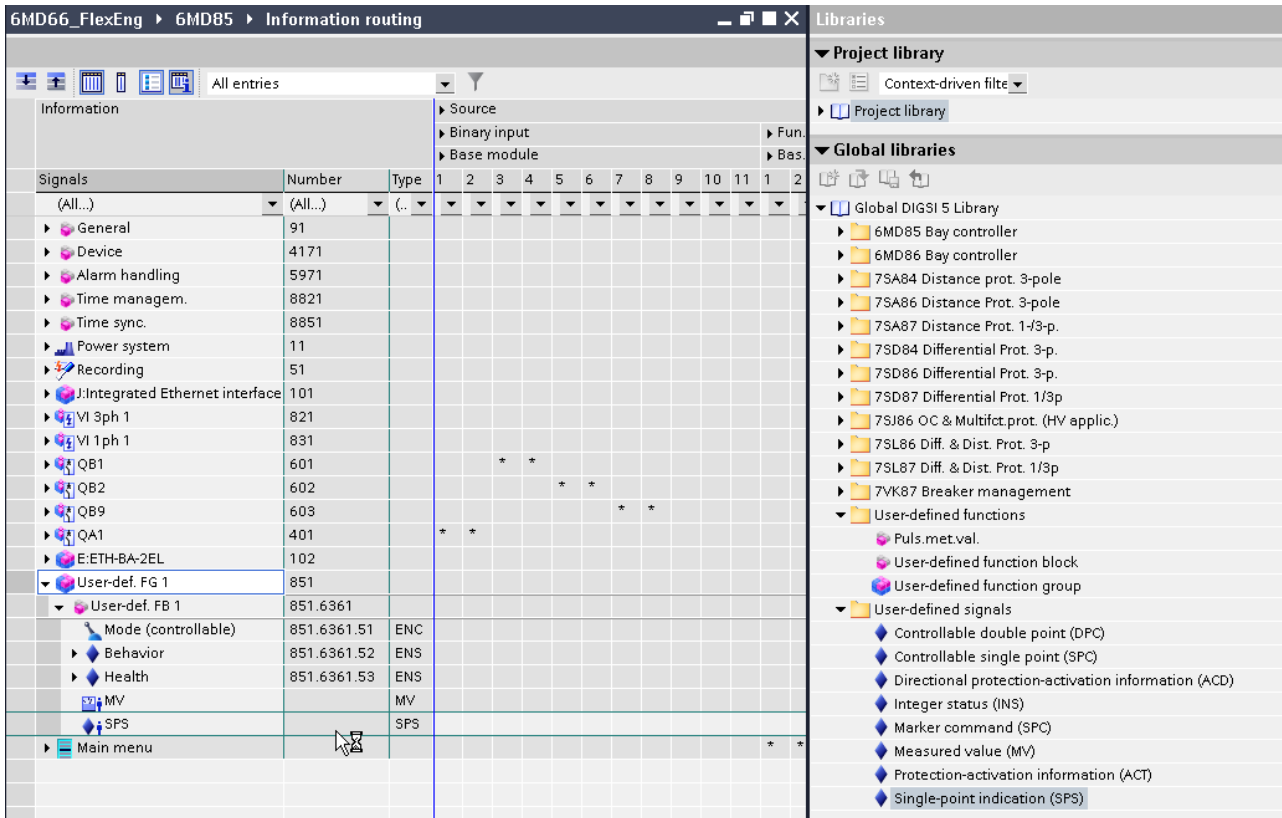


Figure 5: Representation of the complete new structure in the "Information routing editor"

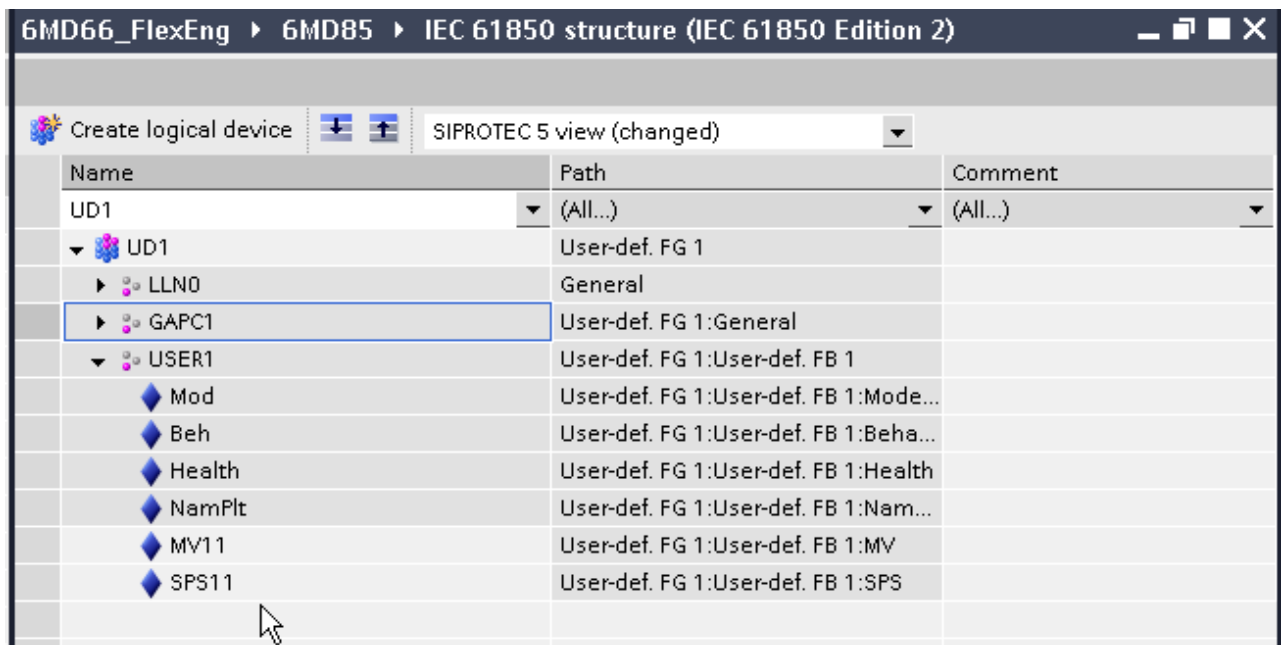


Figure 6: Representation in the "IEC 61850 structure editor"

The signals can now be moved and adjusted at will in the "IEC 61850 structure editor".

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

In the "Name" column the data is described in the IEC 61850 nomenclature and can be renamed within the limits of the standard. In the right column the "Path" appears with the user-specific texts, equally called description. These texts can easily be adjusted in the "Information routing editor".

With the help of this editor a flexible arrangement of the information from the IEC 61850 view can be achieved in DIGSI 5.

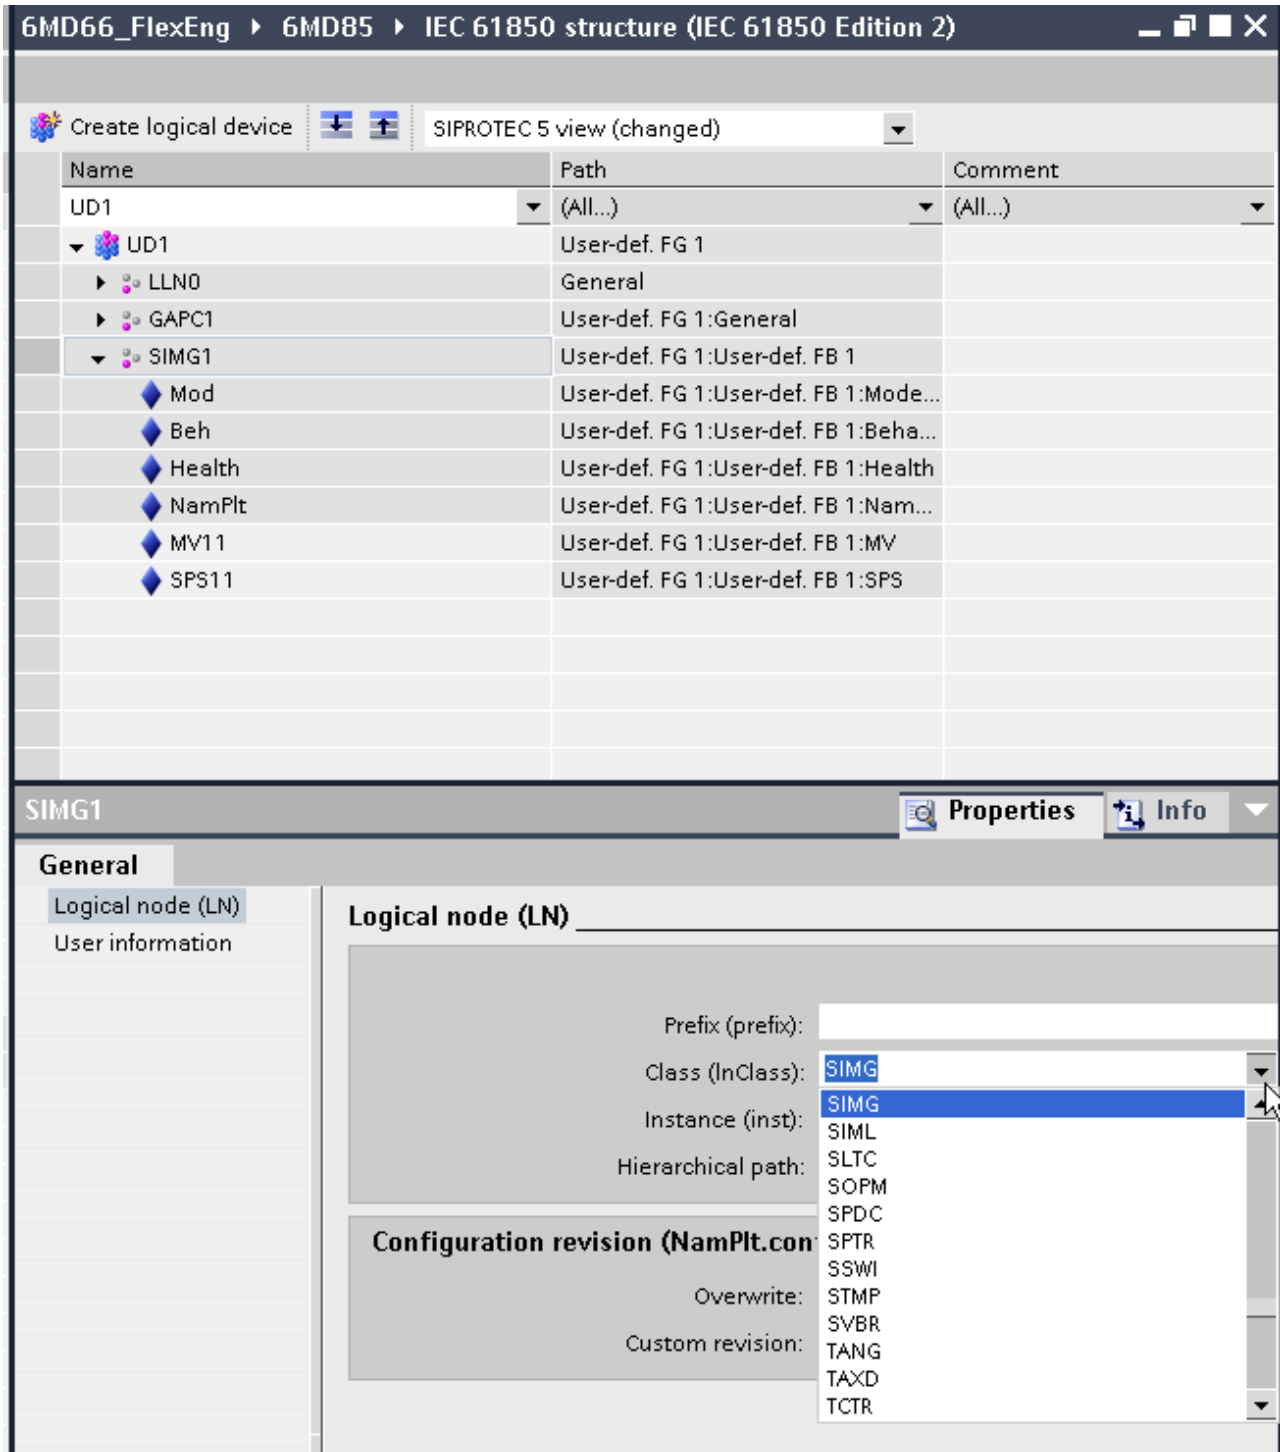


Figure 7: List box for names of the logical nodes (LN) for assigning the logical USER1 to the LnClass SIMG

The function block creates a logical node which at first is called "UD1" for user-defined. This node is renamed "SIMG" in DIGSI . To this purpose a selection of LN names according to IEC61850-7-4 is provided.

Figure 8 shows the newly created function SF6 Alarms and other data objects created and the desired names InsulationAlarm, InsulationBlock, InsulationTrip and Pressure Alarm, as well as the measured values InsGas Pressure, Density and Temperature in the "Information routing editor".

The blue icon "Person" indicates that it is user-created information.

▼ SF6 Alarms	852		
▼ LimitSuperv	852.6361		
Mode (controllable)	852.6361.51	ENC	
▶ Behavior	852.6361.52	ENS	
▶ Health	852.6361.53	ENS	
InsulationAlarm		SPS	
InsulationBlock		SPS	
InsulationTrip		SPS	
PressureAlarm		SPS	
InsGasPressure		MV	
Density		MV	
Temperature		MV	
▶ Main menu			

Figure 8: Object view in the "Information routing editor"

Project tree	Project14 ▶ 6MD86 20mA ▶ IEC 61850 structure (IEC 61850 Edition 2)	
Devices	Create logical device	SIPROTEC 5 view (changed)
▼ Project14	Name	Path
Single-line configuration	(All...)	(All...)
Add new device	VI3p1_Energy	VI 3ph 1:Energy
Devices and networks	VI3p1_5051 OC3phase1	VI 3ph 1:50/51 OC-3ph 1
6MD86_DBB	VI1p1	VI 1ph 1
6MD86_PMU_India	VI1p1_FN1_OMV_Fund_1ph	VI 1ph 1:Fundam
6MD86_DBB_2012_06_20	Mod3_FN1_CorChannel	F.ETH-BA-2EL_1:Channel 1
7VK87 Type 2	▼ SF6_Alarming	SF6 Alarms
6MD86 20mA	▶ LLN0	General
Device information	▶ GAPC1	SF6 Alarms:General
Hardware and protocols	▶ SIMG1	SF6 Alarms:LimitSuperv
Measuring-points routi...	Mod	SF6 Alarms:LimitSuperv:Mode (controllable)
Function-group connec...	Beh	SF6 Alarms:LimitSuperv:Behavior
Information routing	Health	SF6 Alarms:LimitSuperv:Health
Communication mappi...	NamPlt	SF6 Alarms:LimitSuperv:Name plate
Settings	InsAlm	SF6 Alarms:LimitSuperv:InsulationAlarm
Function charts	InsBlk	SF6 Alarms:LimitSuperv:InsulationBlock
Display pages	InsTr	SF6 Alarms:LimitSuperv:InsulationTrip
Safety and security	PresAlm	SF6 Alarms:LimitSuperv:PressureAlarm
IEC 61850 reports and ...	Pres	SF6 Alarms:LimitSuperv:InsGasPressure
IEC 61850 structure	Den	SF6 Alarms:LimitSuperv:Density
	Trp	SF6 Alarms:LimitSuperv:Temperature

Figure 9: Adjusting the IEC 61850 view with the "IEC 61850 structure editor"

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

The original SIPROTEC 5 object model remains unaffected by the assignments in this editor because each object has two designations: the "Siemens name" and the "IEC 61850 name". In this case, the Siemens name is modified while the IEC 61850 name is kept.

The four alarms are created as individual messages (type SPS, single point information with status) and generated in the CFC as corresponding limit value indications.

The three measured values for pressure, density and temperature are created as measured values (type MV) and generated from the captured 20mA values equally in the CFC.

1.5 Conclusion

Using the "IEC 61850 structure editor" as well as the options of the DIGSI library allows the modeling of the IEC61850 interface whereby the device view on the information remains completely unaltered while it is possible to freely model the project-specific information. This means that the freedom offered by IEC 61850 can be used where appropriate without interfering with the classical information view. As a result the IEC61850 expert and the protection expert both are provided with their own familiar view on the device.

SIPROTEC 5 Application

Flexible Engineering – Modeling the System with the Options of IEC 61850

Published by
Siemens AG 2016
Energy Management Division
Digital Grid
Automation Products
Humboldtstr. 59
90459 Nuremberg, Germany

www.siemens.com/siprotec

For more information,
please contact our
Customer Support Center.

Tel.: +49 180 524 70 00

Fax: +49 180 524 24 71

(Charges depending on provider)

Email: support.energy@siemens.com

© 2016 Siemens. Subject to changes and errors.
The information given in this document only contains
general descriptions and/or performance features which
may not always specifically reflect those described, or
which may undergo modification in the course of further
development of the products. The requested performance
features are binding only when they are expressly agreed
upon in the concluded contract.

For all products using security features of OpenSSL, the
following shall apply:
This product includes software developed by the OpenSSL
Project for use in the OpenSSL Toolkit.
(<http://www.openssl.org/>)
This product includes cryptographic software written by
Eric Young (eay@cryptsoft.com)
This product includes software written by Tim Hudson
(tjh@cryptsoft.com)
This product includes software developed by Bodo Moeller.