

7SJ50 numerical overcurrent-time/overload protection relay

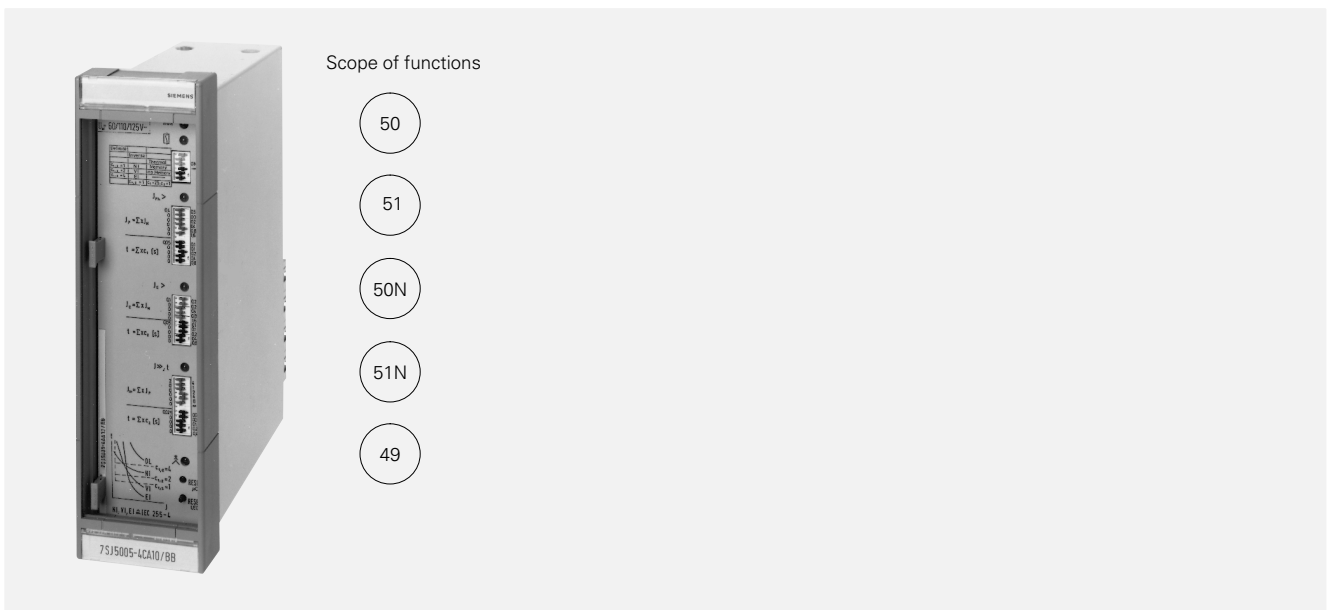


Fig. 1
7SJ50 numerical overcurrent-time/overload protection relay

Application

The 7SJ50 is a numerical protection relay which can be used for definite-time or inverse-time overcurrent protection or for thermal overload protection.

As an overcurrent-time and earth-fault protection relay, the 7SJ50 can protect radial feeders as well as small or medium sized machines and transformers.

It can be used as back-up protection for differential and distance relays in HV and EHV feeder protection schemes.

It can also be used as overload protection for motors, transformers and cables.

By use of the directional relay 7SP20, the 7SJ50 can also be applied to ring feeders or to parallel lines with a single infeed.

Construction

All components, including the DC/DC converter are located on a single PCB. The device can be supplied in three case variations. The model for panel surface mounting is supplied with two-tier terminals accessible from the front. The variants for panel flush mounting or cubicle mounting have rear connection terminals and are available with or without glass cover.

Implemented functions

- Overcurrent time protection with selectable characteristics (inverse or definite-time)
- Directional overcurrent-time protection with directional relay 7SP20
- Overload protection selectable without or with memory (thermal replica)
- Overload protection with start-up time monitoring (locked rotor)
- Additional high set (instantaneous) o/c elements available with all characteristics
- Phase-failure protection
- Earth-fault protection

Mode of operation

The measuring quantities from the C.T.s are galvanically isolated, transformed and shunted by input transducers and resistor circuits. The current proportional analog measuring voltages are then converted into digital values and further processed by a microcomputer. Based on the measured values and the selected characteristic and settings, it computes the tripping time.

Measurement is performed on all phases.

Settings

Settings are performed by dual-in-line switches on the front panel.

Self monitoring

All important software components are monitored continuously. Any irregularities in the hardware or the program sequence are detected and alarmed. As a result, the security and availability of the protection relay are significantly improved.

Overcurrent and Distance Relays

7SJ50 numerical overcurrent–time/overload protection relay

Overcurrent–time protection

The function is based on a common phase measurement. A definite–time or an inverse–time characteristic can be selected. For the earth currents, the same type of characteristic is used as for the phase currents. For the definite time characteristic, the tripping time t is computed as follows:

$$t = C \cdot t_p$$

Three different inverse–time characteristics according to BS 142 resp. IEC 255–4 are available:

Normal inverse (Fig. 2)

$$t = \frac{0.14}{(I/I_p)^{0.02} - 1} \cdot t_p$$

Very inverse (Fig. 3)

$$t = \frac{13.5}{I/I_p - 1} \cdot t_p$$

Extremely inverse (Fig. 4)

$$t = \frac{80}{(I/I_p)^2 - 1} \cdot t_p$$

- t tripping time
- t_p time multiplier
- I fault current
- I_p current setting
- C settable factor 1, 2 or 4

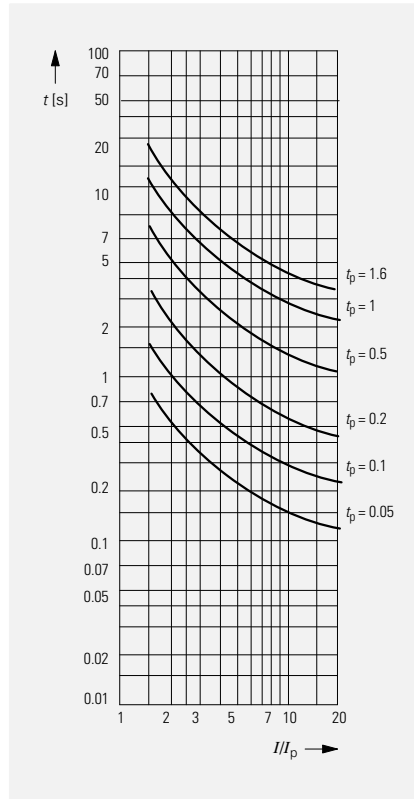


Fig. 2
Tripping time characteristics normal inverse

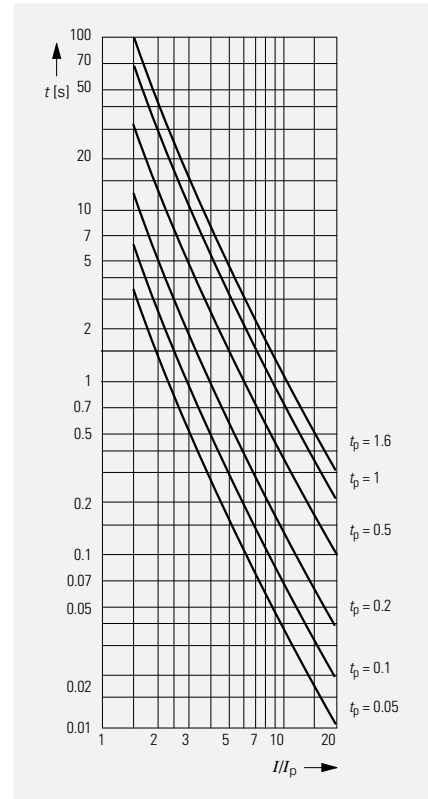


Fig. 4
Tripping time characteristics extremely inverse

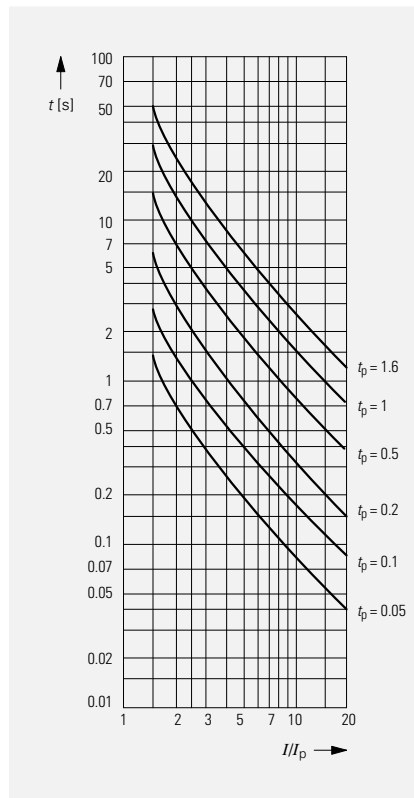


Fig. 3
Tripping time characteristics very inverse

7SJ50 numerical overcurrent–time/overload protection relay

Overload protection

If the overload protection without thermal memory feature is selected the characteristic shown in Fig. 5 is valid for fault currents

$$I \geq 1.1 \cdot I_p$$

For different settings of t_p , the tripping time t can be computed as follows

$$t = \frac{35}{(I/I_p)^2 - 1} \cdot t_p$$

By using the overload protection with memory feature, the preload with all variations is taken into account.

The tripping time t can be computed using the following equation (total memory according to IEC 255–8)

$$t = \tau \cdot \ln \frac{(I/I_p)^2 - (I_{pre}/I_p)^2}{(I/I)^2 - k^2}$$

t tripping time after start of overload

τ 35.5 t_p

I_p current setting

I_{pre} previous current

k 1 (acc. to IEC 255)

t_p time multiplier

I overload current

\ln natural logarithm

Fig. 6 and Fig. 7 show the tripping time characteristics for total memory without (Fig. 6) and with (Fig. 7) 80 % preload.

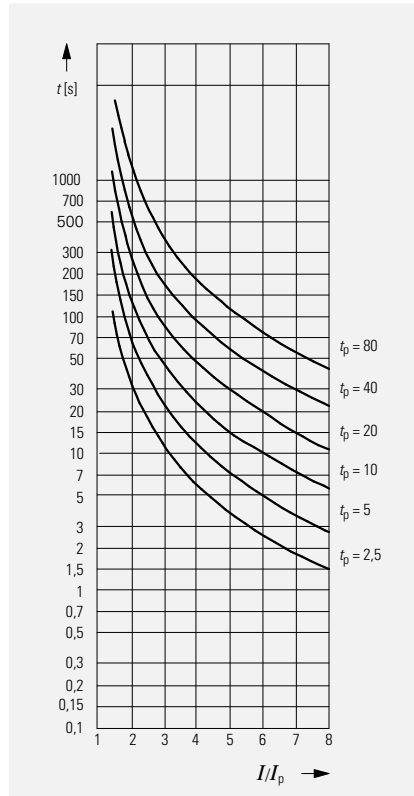


Fig. 5
Tripping time characteristics without memory feature

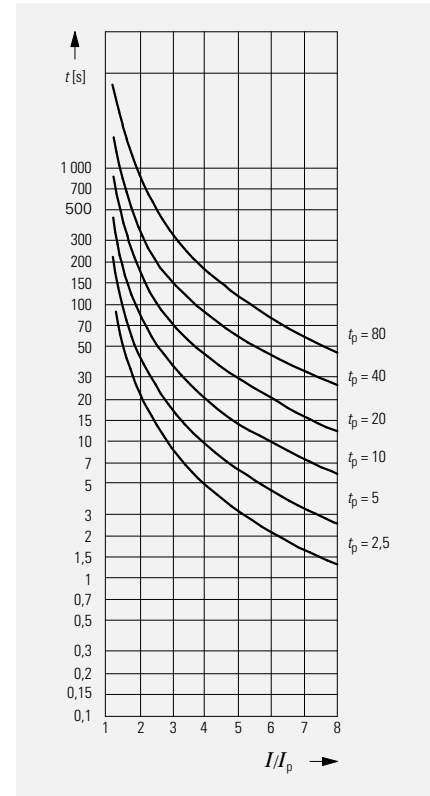


Fig. 7
Tripping time characteristics with memory feature (no preload)

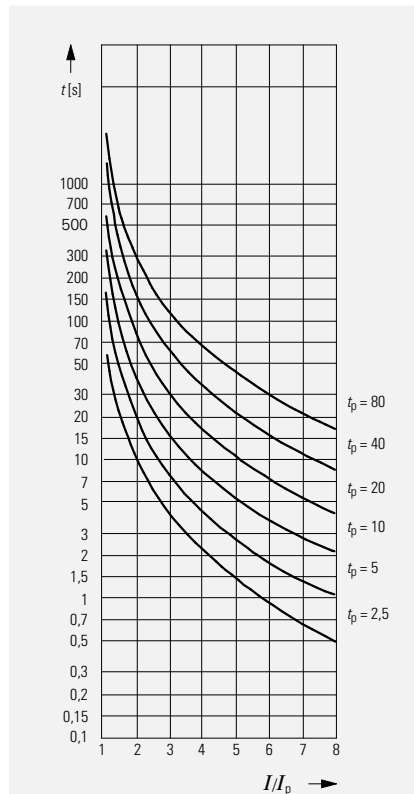


Fig. 6
Tripping time characteristics with memory feature (80 % preload)

Overcurrent and Distance Relays

7SJ50 numerical overcurrent-time/overload protection relay

Start-up time monitoring

In the overload protection mode, an additional settable time stage is available for monitoring the motor start-up time. It becomes effective if the current exceeds a fixed value of 2.5 times the setting current I_p and the relay issues a tripping command.

Phase-failure protection

A phase unbalance function is available which detects a missing phase current if the current in the other phases is above $0.25 I_p$. 10 s after the detection of a phase unbalance, a trip or an alarm is issued.



Earth-fault protection

The implemented earth-fault protection function can be applied if the earth-fault current exceeds 10 % of the rated transducer current. This is normally valid for earthed systems e. g. in four-wire systems e. g. in four-wire systems or low-voltage motors. The earth-current element (I_E) has a separate timer.

Instantaneous high set o/c element

For short-circuit protection, an instantaneous high set overcurrent element with a settable time is available to prevent response to inrush current. This element has always a definite-time characteristic.

Application examples

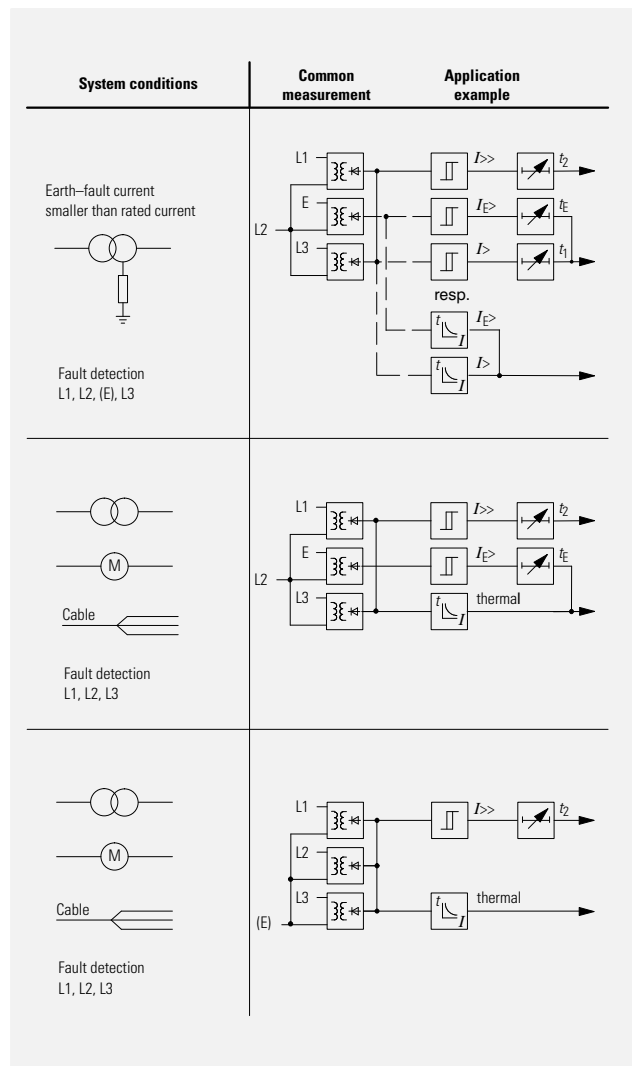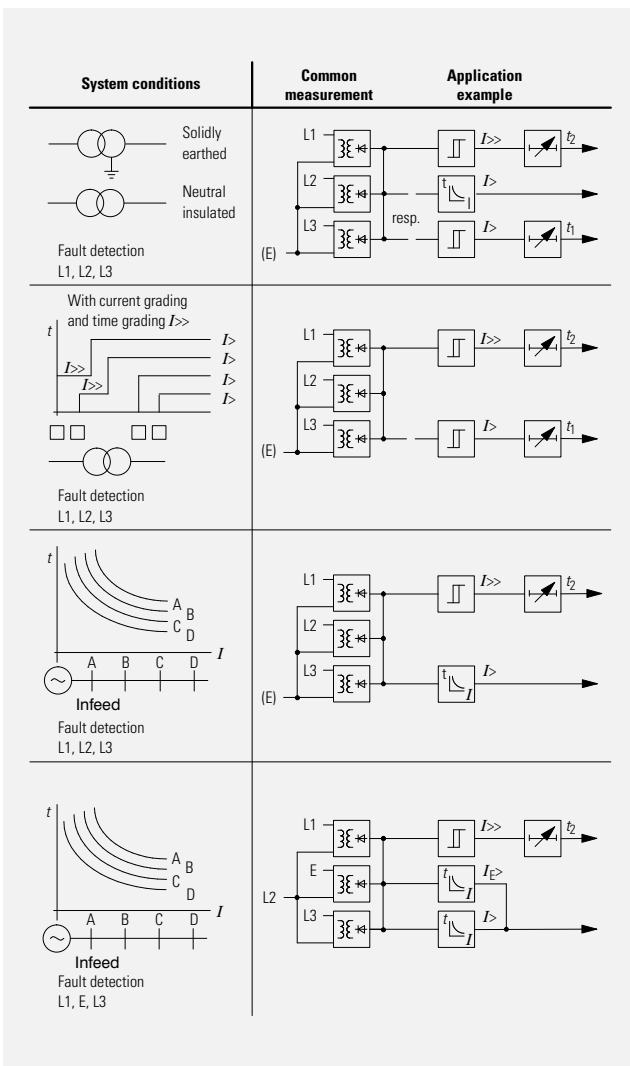

Overcurrent and Distance Relays

7SJ50 numerical overcurrent–time/overload protection relay

Technical data

Input circuits	Rated current I_N Rated frequency f_N Thermal overload capability of current inputs continuous 10 s 1 s Burden of current inputs at I_N	1 or 5 A 50/60 Hz 4 x I_N 30 x I_N 300 x I_N approx. 0.5 VA	
DC voltage supply via integrated DC/DC converter	Rated auxiliary voltage V_{aux} /permissible ranges Ripple content Power consumption, quiescent energized	24, 48 V DC 60, 110, 125 V DC 220, 250 V DC <12 % approx. 5 W approx. 7 W	/19 to 56 V DC /48 to 144 V DC /176 to 288 V DC
Setting ranges			Settable in steps of:
Definite–time overcurrent protection	Current $I >$ Response value of current I_p Tripping time t_p Current $I \gg$ Response value of current I_p Tripping time t_p Earth current $I_{E >}$ Response value of earth current I_E Tripping time t_p Pick–up tolerances for I_p, I_E for t_p	0.4 to 3.55 x I_N 0.05 to 6.4 s 2 to 19 x $I_p^{1)}$, ∞ 0.025 to 3.2 s 0.1 to 3.2 x I_N 0.05 to 6.4 s ± 5 % of set value I_p, I_E ± 3 % or ± 10 ms	0.05 x I_N $C_1 \cdot 0.05$ s, $C_1 = 1, 2, 4$ $1 \times I_p$ $C_3 \cdot 0.025$ s, $C_3 = 1, 2, 4$ $0.1 \times I_N$ $C_2 \cdot 0.05$ s, $C_2 = 1, 2, 4$ – –
Inverse–time overcurrent protection	Current $I >$ Setting value of current I_p Time multiplier t_p Pick–up tolerances for I_p for t_p normal and very inverse extremely inverse Current $I \gg$ (definite–time characteristic) Response value of current I_p Tripping time t_p Pick–up tolerances for I_p for t_p Earth current $I_{E >}$ Setting value of earth current I_E Time multiplier t_p Pick–up tolerances for I_E for t_p normal and very inverse extremely inverse	0.4 to 3.55 x I_N 0.05 to 1.6 s ± 5 % at $1.1 \times I_p$ ± 5 % at $10 \times I_p$ ± 7.5 % at $10 \times I_p$ 2 to 19 x $I_p^{1)}$, ∞ 0.025 to 0.8 s ± 5 % of set value I_p ± 3 % or ± 10 ms 0.1 to 3.2 x I_N 0.05 to 1.6 s ± 5 % of set value ± 5 % at $10 \times I_p$ ± 7.5 % at $10 \times I_p$	0.05 x I_N 0.05 s – – – $1 \times I_p$ 0.025 s – – $0.1 \times I_N$ 0.05 s – –
Overload protection without/with memory feature	Current $I >$ Setting value of current I_p Time multiplier t_p corresponds to t_6 – time (to IEC 255) Pick–up tolerances for I_p for t_p Current $I \gg$ (definite–time characteristic) Response value of current I_p Tripping time $t_{p \gg}$ Earth current $I_{E >}$ (definite–time characteristic) Response value of earth current I_p Tripping time t_E Pick–up tolerances for $I \gg, I_{E >}$ for t_p, t_E	0.4 to 3.55 x I_N 2.5 to 80 s ± 5 % at $1.1 \times I_p$ ± 7.5 % at $I = 6 \times I_p$ 2 to 19 x $I_p^{1)}$, ∞ 0.025 to 0.8 s ²⁾ 0.1 to 3.2 x I_N 0.05 to 1.6 s ± 5 % of set value ± 3 % or ± 10 ms	0.05 x I_N 2.5 s – – $1 \times I_p$ 0.025 s $0.1 \times I_N$ 0.05 s – –
Start time monitoring	Operating criteria Start time t_{STA}	$I > 2.5 \times I_p$ 1.25 to 40 s	– 1.25 s

1) Maximum setting value = 60 I_N .

2) By using locked rotor: ON $t_p \gg = 50$ ms.

Overcurrent and Distance Relays

7SJ50 numerical overcurrent–time/overload protection relay

Technical data (continued)

Phase-failure protection	Operating criteria Delay t_{ph}	Failure of one phase and $I/I_p \geq 0.25 \pm 0.05$ 10 s ± 0.5 s
Pick-up tolerances	Influence on the current paths Auxiliary voltage $0.8 \leq V_{aux}/V_{aux N} \leq 1.15$ Frequency $0.95 \leq f/f_N \leq 1.05$ Harmonics up to 10 % of 3rd harmonic up to 10 % of 5th harmonic Temperature –5 to 20 °C 20 to 55 °C Influence on operating time	≤ 0.6 % ≤ 0.1 % per Hz ≤ 1.3 % per 1 % of 3rd harmonic ≤ 1 % per 1 % of 5th harmonic ≤ 0.6 % per 10 K ≤ 1.4 % per 10 K not measurable
Contacts	Number of trip relays Contacts per relay Switching capacity make break Switching voltage Permissible current continuous 0.5 s Number of alarm relays/malfunction alarm relays Contacts per relay Switching capacity make/break Switching voltage Permissible current	2 2 NO 1 000 W/VA 30 W/VA 250 V AC/DC 5 A 30 A 3/1 1 NO/ 1 NC 20 W/VA 250 V AC/DC 1 A
Construction	For panel surface mounting Weight approx. For panel flush mounting/cubicle mounting Weight approx.	7XP20 20 housing 6 kg 7XP20 20 housing 5 kg
Input	Number of input relays Power consumption, energized DC operating voltage	1 0.075 to 1.7 W, depending on DC operating voltage 24 to 60 V 110 to 250 V

Selection and ordering data

7SJ50 numerical overcurrent–time/ overload protection relay	Order No. 7SJ50 0 □ – □ □ □ □ 0
Rated current I_N 1 A 5 A	↑ 1 ↑ 5
Rated auxiliary voltage V_{aux} for the built-in converter 24, 48 V DC 60, 110, 125 V DC 220, 250, V DC	↑ 2 ↑ 4 ↑ 5
Construction Panel flush mounting Panel surface mounting Panel surface mounting (without glass cover)	↑ C ↑ D ↑ E
Directional relay interface without termination connector with termination connector	↑ A 0 ↑ A 1

7SJ50 numerical overcurrent–time/overload protection relay

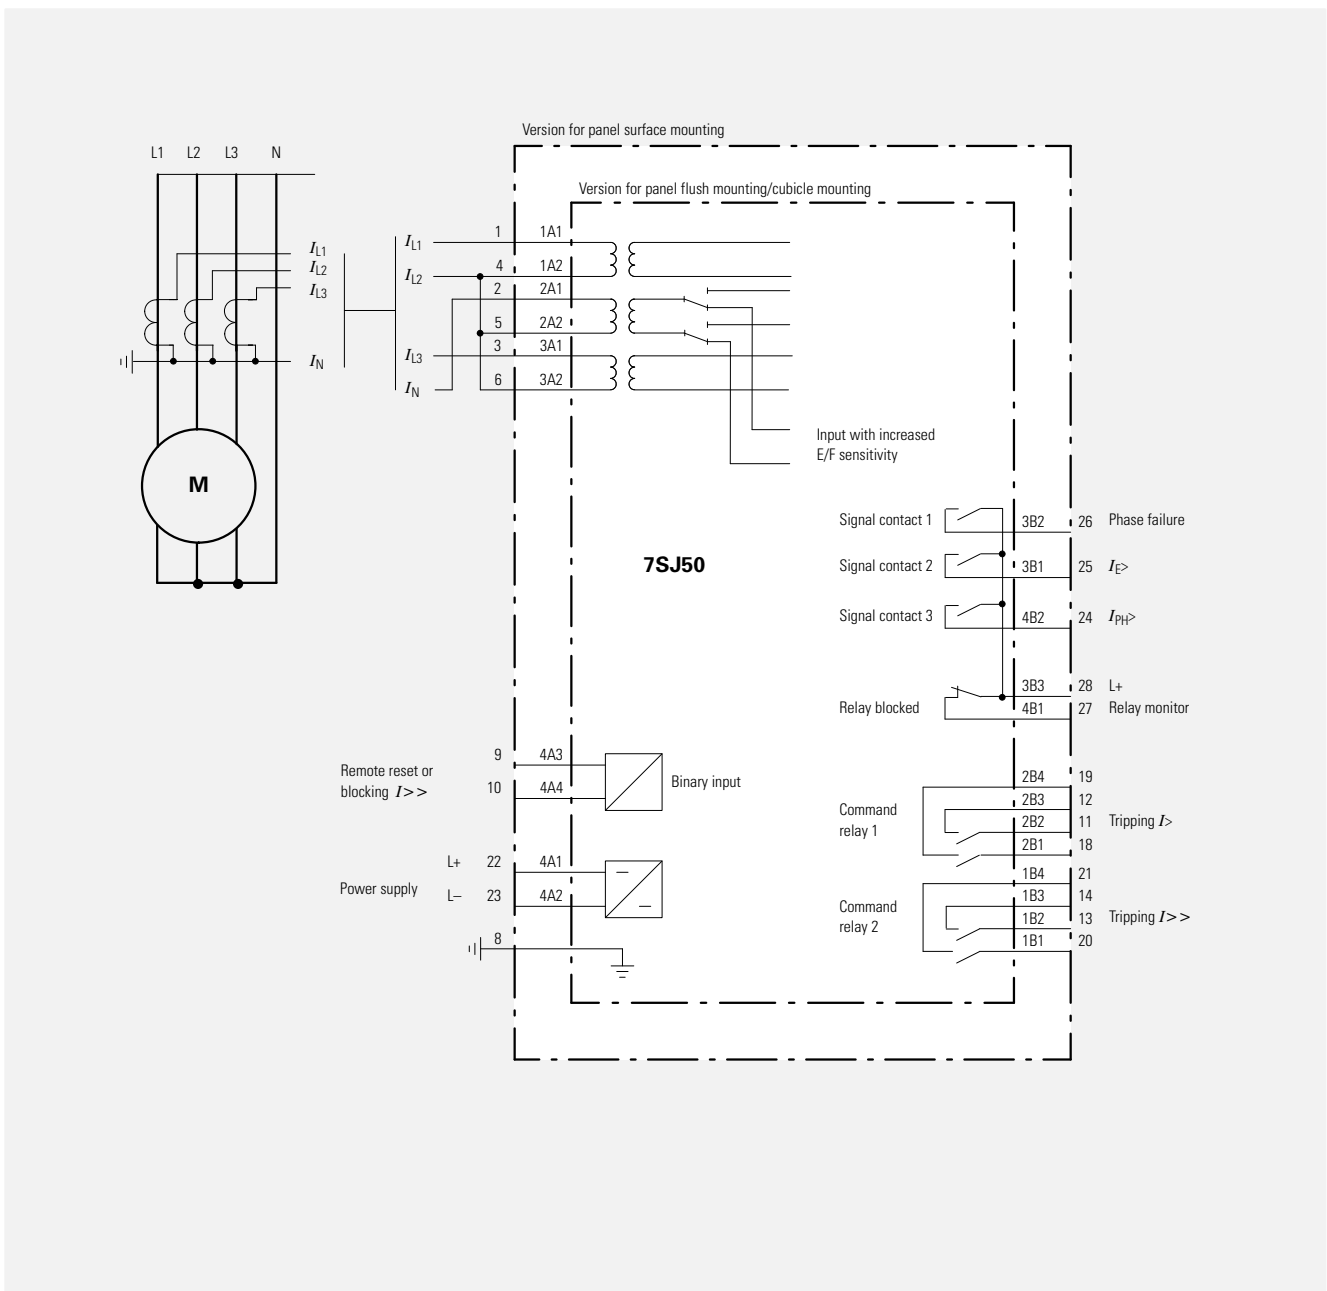


Fig. 8 Connection diagram for motor overload and short-circuit protection with sensitive detection of neutral current (four-wire system)

Overcurrent and Distance Relays

7SJ50 numerical overcurrent-time/overload protection relay

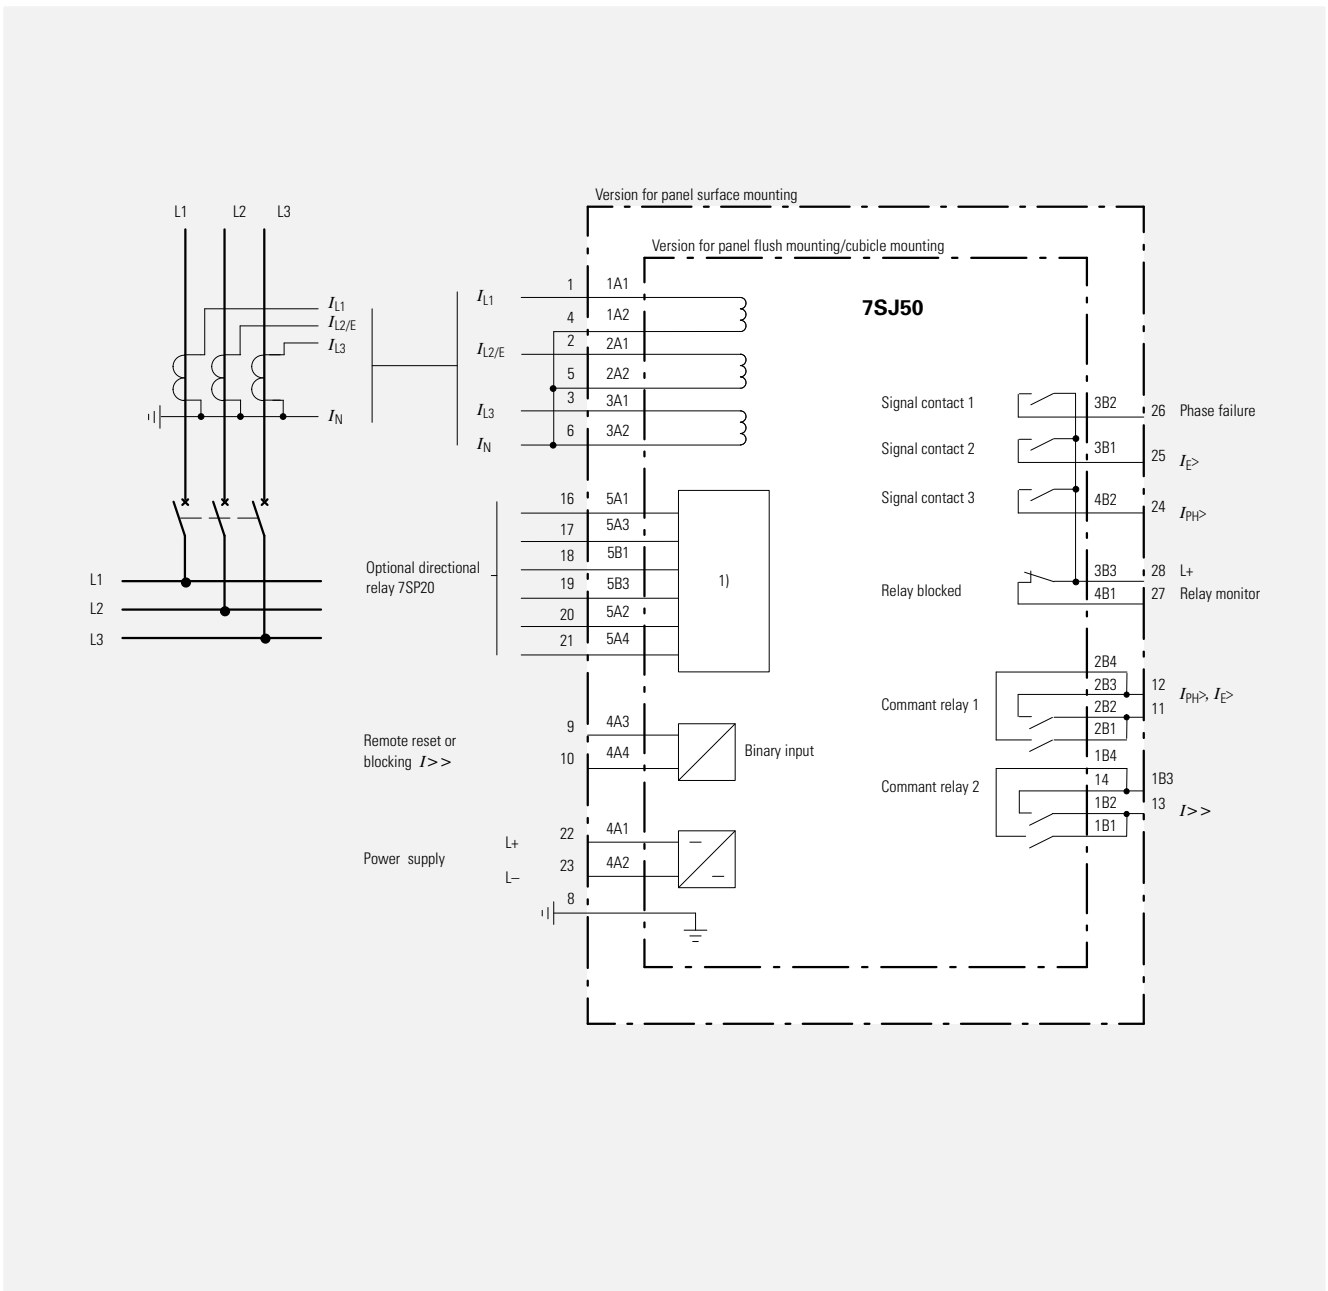


Fig. 9 Connection diagram for motor overload and short-circuit protection with sensitive detection of neutral current (four-wire system)

1) Option (only with 7SJ50.0-.. A10. connections for directional relay)

Dimension drawings in mm

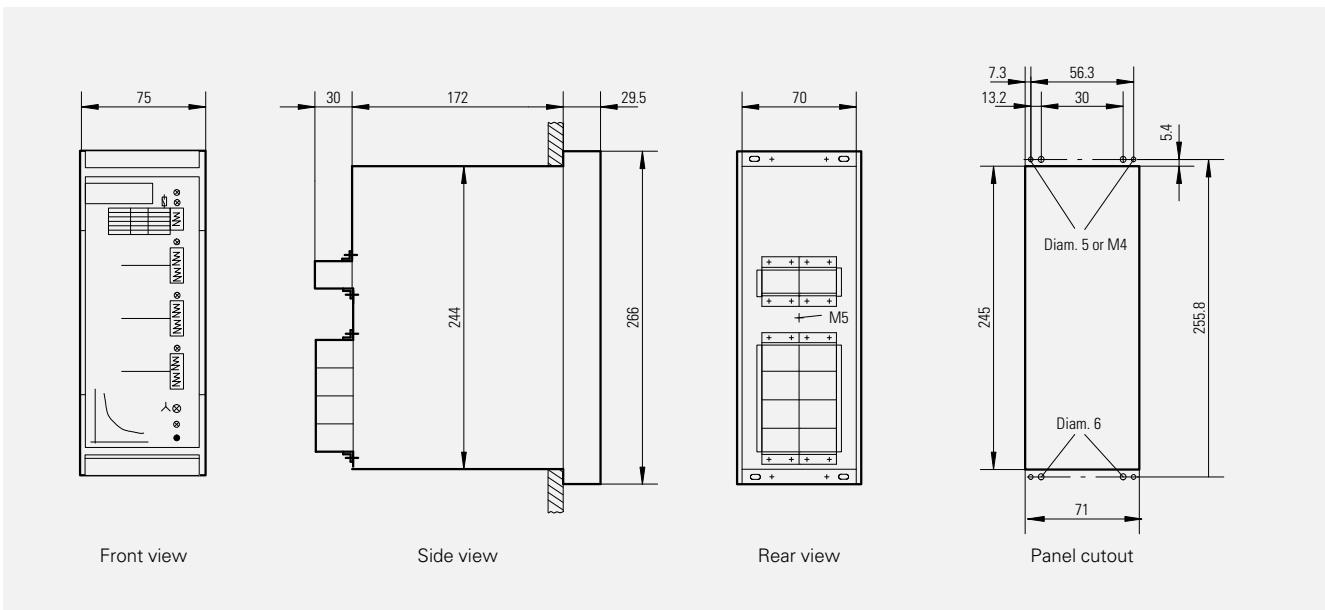


Fig. 10
7SJ50 with housing 7XP2020-2 (for panel flush mounting)

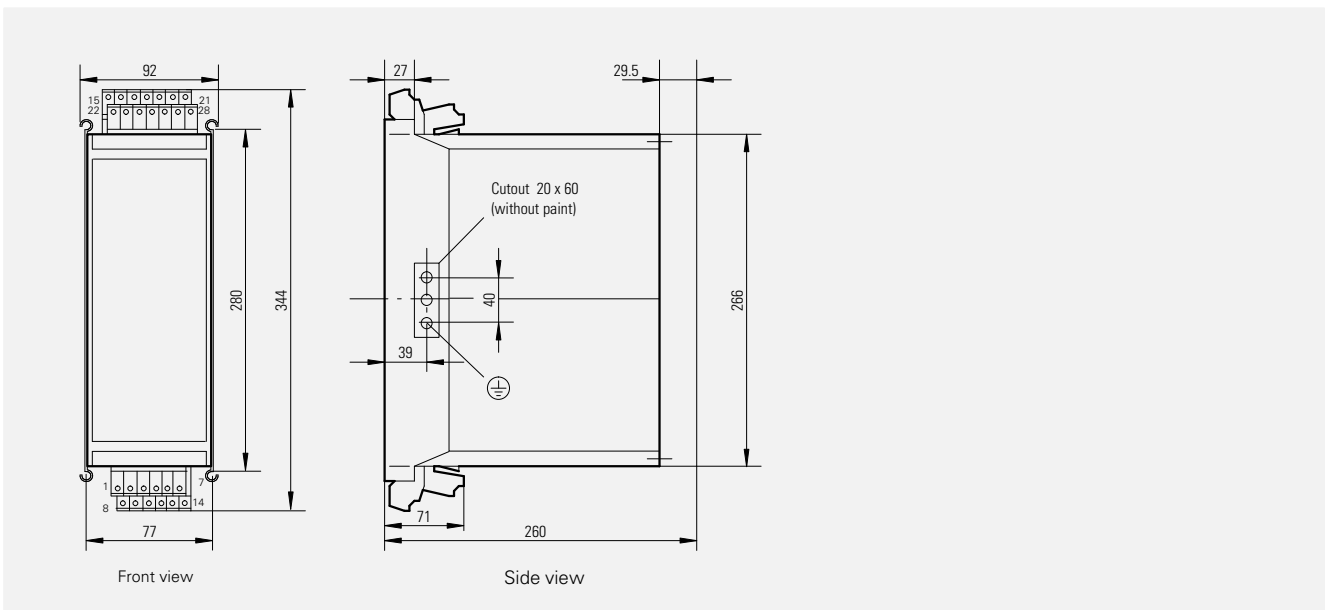


Fig. 11
7SJ50 with housing 7XP2020-1 (for panel surface mounting)

Conditions of Sale and Delivery • Export Regulations • Trademarks • Dimensions

Conditions of Sale and Delivery

Subject to the
General Conditions of Supply and Delivery
for Products and Services of the
Electrical and Electronic Industry
and to any other conditions agreed upon
with the recipients of catalogs.

■ The technical data, dimensions and
weights are subject to change unless
otherwise stated on the individual pages
of this catalog.

The illustrations are for reference only.

We reserve the right to adjust the prices
and shall charge the price applying on
the date of delivery.

A 9.91 a

Export Regulations

In accordance with present German and
US export regulations export licences (da-
ted 02.95) are not required for the prod-
ucts listed in this catalog.
Export and re-export are therefore

permissible without the approval of the
relevant authorities except where current
German export regulations contain coun-
try-specific restrictions.

Subject to change.
Relevant are the criteria stated in the
delivery note and in the invoice.
An export licence may be required due
to country-specific application of the
product.

Trademarks

All product designations used are trade-
marks or product names of Siemens AG
or of suppliers.

Dimensions

All dimensions in this catalog are given in
mm

Responsible for

Technical contents: Norbert Schuster,
Siemens AG, EV S T11, Nürnberg

General editing: Claudia Kühn-Sutiono,
Siemens AG, EV MK 2, Erlangen

Bereich
Energieübertragung und -verteilung
Geschäftsgebiet
Zähler, Sekundär- und Netzleittechnik
P. O. Box 48 06
D-90026 Nürnberg



Power
Transmission
and Distribution